



Town of Topsham, Maine
100 Main Street
Topsham, Maine 04086
www.topshammaine.com
Codes Enforcement Office
PH (207) 725-1723/ FX (207)725-1737

Foam Plastic Insulation For Projects Regulated by the IBC Code

The common use of foam plastic in a building as insulation is subject to both the Maine Uniform Building and Energy Code (MUBEC) and Maine Law Title 25§2447-B. Topsham enforces the provisions of MUBEC, however your project is likely subject to both laws. Whether one law supersedes or modifies the other is beyond the authority of this office to determine, however as the property owner, you are responsible for compliance with all laws that apply to your project. This office requires compliance with MUBEC. Attached are a few memos issued by the State Fire Marshal's Office outlining their position regarding the use of various foam products. If you have any questions regarding these memos or products, please contact the State Fire Marshal Office at (207) 626-3889.

See attached:

- IBC section 2603; see 2603.9 for exceptions to Thermal Barrier requirements. The approved tests mentioned are typically in the form of a report generated by ICC Evaluation Services (ES).
- IBC section 803. This section is referenced by 2603.9 where foam is also the interior finish
- Title 25§2447-B
- Letters issued by the State Fire Marshal's office that modify the title. *Note in all SFMO letters, certification of correct installation is to be provided to property owners by the installer.*

CHAPTER 26

PLASTIC

SECTION 2601 GENERAL

2601.1 Scope. These provisions shall govern the materials, design, application, construction and installation of foam plastic, foam plastic insulation, plastic veneer, interior plastic finish and *trim* and light-transmitting plastics. See Chapter 14 for requirements for *exterior wall* finish and *trim*.

SECTION 2602 DEFINITIONS

2602.1 General. The following words and terms shall, for the purposes of this chapter and as used elsewhere in this code, have the meanings shown herein.

FIBER REINFORCED POLYMER. A polymeric composite material consisting of reinforcement fibers impregnated with a fiber-binding polymer which is then molded and hardened.

FIBERGLASS REINFORCED POLYMER. A polymeric composite material consisting of glass reinforcement fibers impregnated with a fiber-binding polymer which is then molded and hardened.

FOAM PLASTIC INSULATION. A plastic that is intentionally expanded by the use of a foaming agent to produce a reduced-density plastic containing voids consisting of open or closed cells distributed throughout the plastic for thermal insulating or acoustical purposes and that has a density less than 20 pounds per cubic foot (pcf) (320 kg/m³).

LIGHT-DIFFUSING SYSTEM. Construction consisting in whole or in part of lenses, panels, grids or baffles made with light-transmitting plastics positioned below independently mounted electrical light sources, skylights or light-transmitting plastic roof panels. Lenses, panels, grids and baffles that are part of an electrical fixture shall not be considered as a light-diffusing system.

LIGHT-TRANSMITTING PLASTIC ROOF PANELS. Structural plastic panels other than skylights that are fastened to structural members, or panels or sheathing and that are used as light-transmitting media in the plane of the roof.

LIGHT-TRANSMITTING PLASTIC WALL PANELS. Plastic materials that are fastened to structural members, or to structural panels or sheathing, and that are used as light-transmitting media in *exterior walls*.

PLASTIC, APPROVED. Any thermoplastic, thermosetting or reinforced thermosetting plastic material that conforms to combustibility classifications specified in the section applicable to the application and plastic type.

PLASTIC GLAZING. Plastic materials that are glazed or set in frame or sash and not held by mechanical fasteners that pass through the glazing material.

THERMOPLASTIC MATERIAL. A plastic material that is capable of being repeatedly softened by increase of temperature and hardened by decrease of temperature.

THERMOSETTING MATERIAL. A plastic material that is capable of being changed into a substantially nonreformable product when cured.

SECTION 2603 FOAM PLASTIC INSULATION

2603.1 General. The provisions of this section shall govern the requirements and uses of foam plastic insulation in buildings and structures.

2603.2 Labeling and identification. Packages and containers of foam plastic insulation and foam plastic insulation components delivered to the job site shall bear the *label* of an *approved agency* showing the manufacturer's name, product listing, product identification and information sufficient to determine that the end use will comply with the code requirements.

2603.3 Surface-burning characteristics. Unless otherwise indicated in this section, foam plastic insulation and foam plastic cores of manufactured assemblies shall have a flame spread index of not more than 75 and a smoke-developed index of not more than 450 where tested in the maximum thickness intended for use in accordance with ASTM E 84 or UL 723. Loose fill-type foam plastic insulation shall be tested as board stock for the flame spread and smoke-developed indexes.

Exceptions:

1. Smoke-developed index for interior *trim* as provided for in Section 2604.2.
2. In cold storage buildings, ice plants, food plants, food processing rooms and similar areas, foam plastic insulation where tested in a thickness of 4 inches (102 mm) shall be permitted in a thickness up to 10 inches (254 mm) where the building is equipped throughout with an automatic fire sprinkler system in accordance with Section 903.3.1.1. The approved *automatic sprinkler system* shall be provided in both the room and that part of the building in which the room is located.
3. Foam plastic insulation that is a part of a Class A, B or C roof-covering assembly provided the assembly with the foam plastic insulation satisfactorily passes FM 4450 or UL 1256. The smoke-developed index shall not be limited for roof applications.
4. Foam plastic insulation greater than 4 inches (102 mm) in thickness shall have a maximum flame spread index of 75 and a smoke-developed index of 450 where tested at a minimum thickness of 4 inches (102 mm), provided the end use is approved in accordance

with Section 2603.9 using the thickness and density intended for use.

5. Flame spread and smoke-developed indexes for foam plastic interior signs in *covered mall buildings* provided the signs comply with Section 402.15.

2603.4 Thermal barrier. Except as provided for in Sections 2603.4.1 and 2603.9, foam plastic shall be separated from the interior of a building by an approved thermal barrier of 1/2-inch (12.7 mm) gypsum wallboard or equivalent thermal barrier material that will limit the average temperature rise of the unexposed surface to not more than 250°F (120°C) after 15 minutes of fire exposure, complying with the standard time-temperature curve of ASTM E 119 or UL 263. The thermal barrier shall be installed in such a manner that it will remain in place for 15 minutes based on FM 4880, UL 1040, NFPA 286 or UL 1715. Combustible concealed spaces shall comply with Section 717.

2603.4.1 Thermal barrier not required. The thermal barrier specified in Section 2603.4 is not required under the conditions set forth in Sections 2603.4.1.1 through 2603.4.1.13.

2603.4.1.1 Masonry or concrete construction. A thermal barrier is not required for foam plastic installed in a masonry or concrete wall, floor or roof system where the foam plastic insulation is covered on each face by a minimum of 1 inch (25 mm) thickness of masonry or concrete.

2603.4.1.2 Cooler and freezer walls. Foam plastic installed in a maximum thickness of 10 inches (254 mm) in cooler and freezer walls shall:

1. Have a flame spread index of 25 or less and a smoke-developed index of not more than 450, where tested in a minimum 4 inch (102 mm) thickness.
2. Have flash ignition and self-ignition temperatures of not less than 600°F and 800°F (316°C and 427°C), respectively.
3. Have a covering of not less than 0.032-inch (0.8 mm) aluminum or corrosion-resistant steel having a base metal thickness not less than 0.0160 inch (0.4 mm) at any point.
4. Be protected by an *automatic sprinkler system* in accordance with Section 903.3.1.1. Where the cooler or freezer is within a building, both the cooler or freezer and that part of the building in which it is located shall be sprinklered.

2603.4.1.3 Walk-in coolers. In nonsprinklered buildings, foam plastic having a thickness that does not exceed 4 inches (102 mm) and a maximum flame spread index of 75 is permitted in walk-in coolers or freezer units where the aggregate floor area does not exceed 400 square feet (37 m²) and the foam plastic is covered by a metal facing not less than 0.032-inch-thick (0.81 mm) aluminum or corrosion-resistant steel having a minimum base metal thickness of 0.016 inch (0.41 mm). A thickness of up to 10 inches (254 mm) is permitted where protected by a thermal barrier.

2603.4.1.4 Exterior walls—one-story buildings. For one-story buildings, foam plastic having a flame spread index of 25 or less, and a smoke-developed index of not more than 450, shall be permitted without thermal barriers in or on *exterior walls* in a thickness not more than 4 inches (102 mm) where the foam plastic is covered by a thickness of not less than 0.032-inch-thick (0.81 mm) aluminum or corrosion-resistant steel having a base metal thickness of 0.0160 inch (0.41 mm) and the building is equipped throughout with an *automatic sprinkler system* in accordance with Section 903.3.1.1.

2603.4.1.5 Roofing. Foam plastic insulation under a roof assembly or roof covering that is installed in accordance with the code and the manufacturer's instructions shall be separated from the interior of the building by wood structural panel sheathing not less than 0.47 inch (11.9 mm) in thickness bonded with exterior glue, with edges supported by blocking, tongue-and-groove joints or other approved type of edge support, or an equivalent material. A thermal barrier is not required for foam plastic insulation that is a part of a Class A, B or C roof-covering assembly, provided the assembly with the foam plastic insulation satisfactorily passes FM 4450 or UL 1256.

2603.4.1.6 Attics and crawl spaces. Within an *attic* or *crawl space* where entry is made only for service of utilities, foam plastic insulation shall be protected against ignition by 1 1/2-inch-thick (38 mm) mineral fiber insulation; 1/4-inch-thick (6.4 mm) wood structural panel, particleboard or hardboard; 3/8-inch (9.5 mm) gypsum wallboard, corrosion-resistant steel having a base metal thickness of 0.016 inch (0.4 mm) or other approved material installed in such a manner that the foam plastic insulation is not exposed. The protective covering shall be consistent with the requirements for the type of construction.

2603.4.1.7 Doors not required to have a fire protection rating. Where pivoted or side-hinged doors are permitted without a fire protection rating, foam plastic insulation, having a flame spread index of 75 or less and a smoke-developed index of not more than 450, shall be permitted as a core material where the door facing is of metal having a minimum thickness of 0.032-inch (0.8 mm) aluminum or steel having a base metal thickness of not less than 0.016 inch (0.4 mm) at any point.

2603.4.1.8 Exterior doors in buildings of Group R-2 or R-3. In occupancies classified as Group R-2 or R-3, foam-filled exterior entrance doors to individual *dwelling units* that do not require a fire-resistance rating shall be faced with wood or other approved materials.

2603.4.1.9 Garage doors. Where garage doors are permitted without a fire-resistance rating and foam plastic is used as a core material, the door facing shall be metal having a minimum thickness of 0.032-inch (0.8 mm) aluminum or 0.010-inch (0.25 mm) steel or the facing shall be minimum 0.125-inch-thick (3.2 mm) wood. Garage doors having facings other than those described above

shall be tested in accordance with, and meet the acceptance criteria of, DASMA 107.

Exception: Garage doors using foam plastic insulation complying with Section 2603.3 in detached and attached garages associated with one- and two-family dwellings need not be provided with a thermal barrier.

2603.4.1.10 Siding backer board. Foam plastic insulation of not more than 2,000 British thermal units per square feet (Btu/sq. ft.) (22.7 mJ/m²) as determined by NFPA 259 shall be permitted as a siding backer board with a maximum thickness of 1/2 inch (12.7 mm), provided it is separated from the interior of the building by not less than 2 inches (51 mm) of mineral fiber insulation or equivalent or where applied as insulation with residing over existing wall construction.

2603.4.1.11 Interior trim. Foam plastic used as interior trim in accordance with Section 2604 shall be permitted without a thermal barrier.

2603.4.1.12 Interior signs. Foam plastic used for interior signs in *covered mall buildings* in accordance with Section 402.16 shall be permitted without a thermal barrier. Foam plastic signs that are not affixed to interior building surfaces shall comply with Chapter 8 of the *International Fire Code*.

2603.4.1.13 Type V construction. Foam plastic spray applied to a sill plate and header of Type V construction is subject to all of the following:

1. The maximum thickness of the foam plastic shall be 3 1/4 inches (82.6 mm).
2. The density of the foam plastic shall be in the range of 1.5 to 2.0 pcf (24 to 32 kg/m³).
3. The foam plastic shall have a flame spread index of 25 or less and an accompanying smoke-developed index of 450 or less when tested in accordance with ASTM E 84 or UL 723.

2603.5 Exterior walls of buildings of any height. *Exterior walls* of buildings of Type I, II, III or IV construction of any height shall comply with Sections 2603.5.1 through 2603.5.7. *Exterior walls* of cold storage buildings required to be constructed of noncombustible materials, where the building is more than one *story* in height, shall also comply with the provisions of Sections 2603.5.1 through 2603.5.7. *Exterior walls* of buildings of Type V construction shall comply with Sections 2603.2, 2603.3 and 2603.4.

2603.5.1 Fire-resistance-rated walls. Where the wall is required to have a fire-resistance rating, data based on tests conducted in accordance with ASTM E 119 or UL 263 shall be provided to substantiate that the fire-resistance rating is maintained.

2603.5.2 Thermal barrier. Any foam plastic insulation shall be separated from the building interior by a thermal barrier meeting the provisions of Section 2603.4, unless special approval is obtained on the basis of Section 2603.9.

Exception: One-story buildings complying with Section 2603.4.1.4.

2603.5.3 Potential heat. The potential heat of foam plastic insulation in any portion of the wall or panel shall not exceed the potential heat expressed in Btu per square feet (mJ/m²) of the foam plastic insulation contained in the wall assembly tested in accordance with Section 2603.5.5. The potential heat of the foam plastic insulation shall be determined by tests conducted in accordance with NFPA 259 and the results shall be expressed in Btu per square feet (mJ/m²).

Exception: One-story buildings complying with Section 2603.4.1.4.

2603.5.4 Flame spread and smoke-developed indexes. Foam plastic insulation, exterior coatings and facings shall be tested separately in the thickness intended for use, but not to exceed 4 inches (102 mm), and shall each have a flame spread index of 25 or less and a smoke-developed index of 450 or less as determined in accordance with ASTM E 84 or UL 723.

Exception: Prefabricated or factory-manufactured panels having minimum 0.020-inch (0.51 mm) aluminum facings and a total thickness of 1/4 inch (6.4 mm) or less are permitted to be tested as an assembly where the foam plastic core is not exposed in the course of construction.

2603.5.5 Test standard. The wall assembly shall be tested in accordance with and comply with the acceptance criteria of NFPA 285.

Exception: One-story buildings complying with Section 2603.4.1.4.

2603.5.6 Label required. The edge or face of each piece of foam plastic insulation shall bear the *label* of an *approved agency*. The *label* shall contain the manufacturer's or distributor's identification, model number, serial number or definitive information describing the product or materials' performance characteristics and *approved agency's* identification.

2603.5.7 Ignition. *Exterior walls* shall not exhibit sustained flaming where tested in accordance with NFPA 268. Where a material is intended to be installed in more than one thickness, tests of the minimum and maximum thickness intended for use shall be performed.

Exception: Assemblies protected on the outside with one of the following:

1. A thermal barrier complying with Section 2603.4.
2. A minimum 1 inch (25 mm) thickness of concrete or masonry.
3. Glass-fiber-reinforced concrete panels of a minimum thickness of 3/8 inch (9.5 mm).
4. Metal-faced panels having minimum 0.019-inch-thick (0.48 mm) aluminum or 0.016-inch-thick (0.41 mm) corrosion-resistant steel outer facings.
5. A minimum 7/8 inch (22.2 mm) thickness of stucco complying with Section 2510.

2603.6 Roofing. Foam plastic insulation meeting the requirements of Sections 2603.2, 2603.3 and 2603.4 shall be permitted as part of a roof-covering assembly, provided the assembly

PLASTIC

with the foam plastic insulation is a Class A, B or C roofing assembly where tested in accordance with ASTM E 108 or UL 790.

2603.7 Plenums. Foam plastic insulation shall not be used as interior wall or ceiling finish in plenums except as permitted in Section 2604 or when protected by a thermal barrier in accordance with Section 2603.4.

2603.8 Protection against termites. In areas where the probability of termite infestation is very heavy in accordance with Figure 2603.8, extruded and expanded polystyrene, polyisocyanurate and other foam plastics shall not be installed on the exterior face or under interior or exterior foundation walls or slab foundations located below grade. The clearance between foam plastics installed above grade and exposed earth shall be at least 6 inches (152 mm).

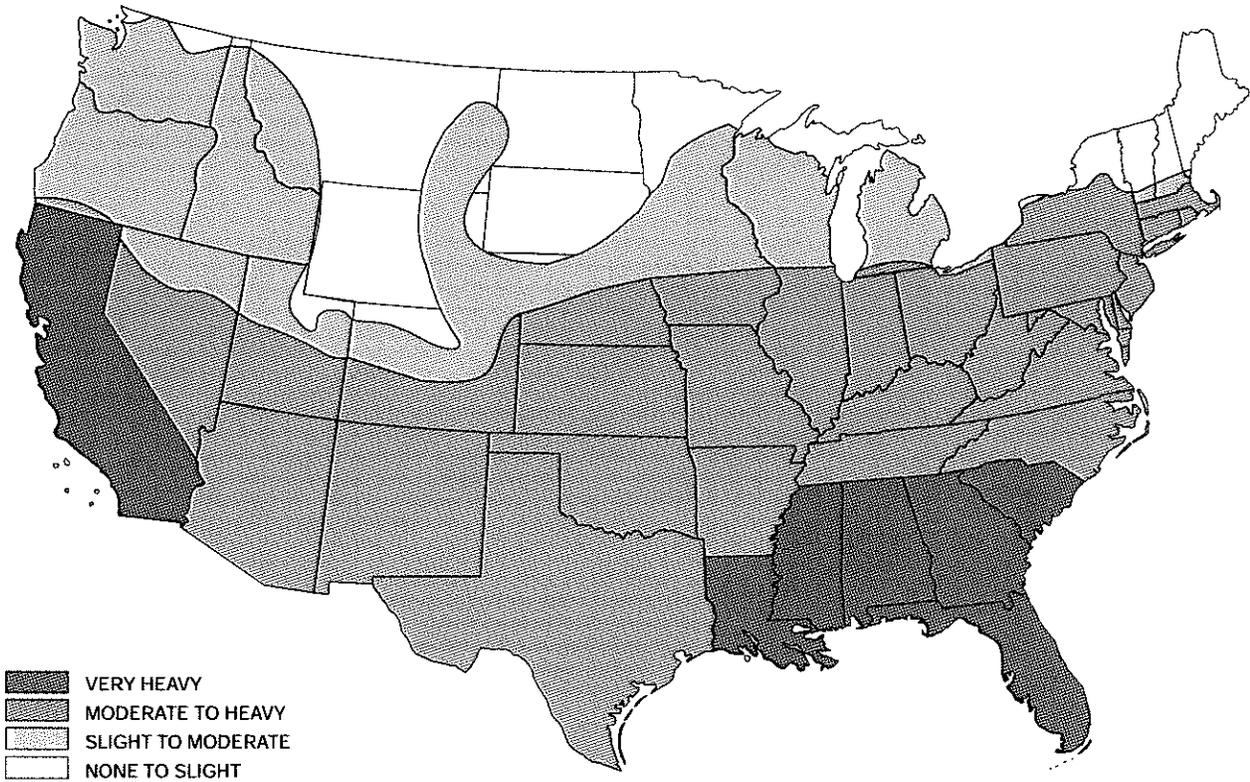
Exceptions:

1. Buildings where the structural members of walls, floors, ceilings and roofs are entirely of non-combustible materials or preservative-treated wood.
2. An approved method of protecting the foam plastic and structure from subterranean termite damage is provided.
3. On the interior side of basement walls.

2603.9 Special approval. Foam plastic shall not be required to comply with the requirements of Sections 2603.4 through 2603.7 where specifically approved based on large-scale tests such as, but not limited to, NFPA 286 (with the acceptance criteria of Section 803.2), FM 4880, UL 1040 or UL 1715. Such testing shall be related to the actual end-use configuration and be performed on the finished manufactured foam plastic assembly in the maximum thickness intended for use. Foam plastics that are used as interior finish on the basis of special tests shall also conform to the flame spread requirements of Chapter 8. Assemblies tested shall include seams, joints and other typical details used in the installation of the assembly and shall be tested in the manner intended for use.

**SECTION 2604
INTERIOR FINISH AND TRIM**

2604.1 General. Plastic materials installed as interior finish or trim shall comply with Chapter 8. Foam plastics shall only be installed as interior finish where approved in accordance with the special provisions of Section 2603.9. Foam plastics that are used as interior finish shall also meet the flame-spread index requirements for interior finish in accordance with Chapter 8. Foam plastics installed as interior trim shall comply with Section 2604.2.



**FIGURE 2603.8
TERMITE INFESTATION PROBABILITY MAP**

CHAPTER 8

INTERIOR FINISHES

SECTION 801 GENERAL

801.1 Scope. Provisions of this chapter shall govern the use of materials used as *interior finishes, trim and decorative materials*.

801.2 Interior wall and ceiling finish. The provisions of Section 803 shall limit the allowable fire performance and smoke development of *interior wall and ceiling finish* materials based on occupancy classification.

801.3 Interior floor finish. The provisions of Section 804 shall limit the allowable fire performance of *interior floor finish* materials based on occupancy classification.

[F] 801.4 Decorative materials and trim. *Decorative materials* and *trim* shall be restricted by combustibility and the flame propagation performance criteria of NFPA 701, in accordance with Section 806.

801.5 Applicability. For buildings in flood hazard areas as established in Section 1612.3, *interior finishes, trim and decorative materials* below the design flood elevation shall be flood-damage-resistant materials.

801.6 Application. Combustible materials shall be permitted to be used as finish for walls, ceilings, floors and other interior surfaces of buildings.

801.7 Windows. Show windows in the exterior walls of the first *story* above grade shall be permitted to be of wood or of unprotected metal framing.

801.8 Foam plastics. Foam plastics shall not be used as *interior finish* except as provided in Section 803.4. Foam plastics shall not be used as interior *trim* except as provided in Section 806.3 or 2604.2. This section shall apply both to exposed foam plastics and to foam plastics used in conjunction with a textile or vinyl facing or cover.

SECTION 802 DEFINITIONS

802.1 General. The following words and terms shall, for the purposes of this chapter and as used elsewhere in this code, have the meanings shown herein.

EXPANDED VINYL WALL COVERING. Wall covering consisting of a woven textile backing, an expanded vinyl base coat layer and a nonexpanded vinyl skin coat. The expanded base coat layer is a homogeneous vinyl layer that contains a blowing agent. During processing, the blowing agent decomposes, causing this layer to expand by forming closed cells. The total thickness of the wall covering is approximately 0.055 inch to 0.070 inch (1.4 mm to 1.78 mm).

FLAME SPREAD. The propagation of flame over a surface.

FLAME SPREAD INDEX. A comparative measure, expressed as a dimensionless number, derived from visual

measurements of the spread of flame versus time for a material tested in accordance with ASTM E 84 or UL 723.

INTERIOR FINISH. *Interior finish* includes *interior wall and ceiling finish* and *interior floor finish*.

INTERIOR FLOOR FINISH. The exposed floor surfaces of buildings including coverings applied over a finished floor or *stair*, including risers.

[F] INTERIOR FLOOR-WALL BASE. Interior floor finish trim used to provide a functional and/or decorative border at the intersection of walls and floors.

INTERIOR WALL AND CEILING FINISH. The exposed interior surfaces of buildings, including but not limited to: fixed or movable walls and partitions; toilet room privacy partitions; columns; ceilings; and interior wainscoting, paneling or other finish applied structurally or for decoration, acoustical correction, surface insulation, structural fire resistance or similar purposes, but not including trim.

SITE-FABRICATED STRETCH SYSTEM. A system, fabricated on site and intended for acoustical, tackable or aesthetic purposes, that is comprised of three elements: (a) a frame (constructed of plastic, wood, metal or other material) used to hold fabric in place, (b) a core material (infill, with the correct properties for the application), and (c) an outside layer, comprised of a textile, fabric or vinyl, that is stretched taut and held in place by tension or mechanical fasteners via the frame.

SMOKE-DEVELOPED INDEX. A comparative measure, expressed as a dimensionless number, derived from measurements of smoke obscuration versus time for a material tested in accordance with ASTM E 84.

TRIM. Picture molds, chair rails, baseboards, handrails, door and window frames and similar decorative or protective materials used in fixed applications.

SECTION 803 WALL AND CEILING FINISHES

803.1 General. *Interior wall and ceiling finish* materials shall be classified for fire performance and smoke development in accordance with Section 803.1.1 or 803.1.2, except as shown in Sections 803.2 through 803.13. Materials tested in accordance with Section 803.1.2 shall not be required to be tested in accordance with Section 803.1.1.

803.1.1 Interior wall and ceiling finish materials. Interior wall and ceiling finish materials shall be classified in accordance with ASTM E 84 or UL 723. Such *interior finish* materials shall be grouped in the following classes in accordance with their flame spread and *smoke-developed indexes*.

Class A: Flame spread index 0-25; smoke-developed index 0-450.

Class B: Flame spread index 26-75; smoke-developed index 0-450.

Class C: Flame spread index 76-200; smoke-developed index 0-450.

Exception: Materials tested in accordance with Section 803.1.2.

803.1.2 Room corner test for interior wall or ceiling finish materials. *Interior wall or ceiling finish* materials shall be permitted to be tested in accordance with NFPA 286. Interior wall or ceiling finish materials tested in accordance with NFPA 286 shall comply with Section 803.1.2.1.

803.1.2.1 Acceptance criteria for NFPA 286. During the 40 kW exposure, the *interior finish* shall comply with Item 1. During the 160 kW exposure, the *interior finish* shall comply with Item 2. During the entire test, the *interior finish* shall comply with Items 3 and 4.

1. During the 40kW exposure, flames shall not spread to the ceiling.
2. During the 160 kW exposure, the *interior finish* shall comply with the following:
 - 2.1. Flame shall not spread to the outer extremity of the sample on any wall or ceiling.
 - 2.2. Flashover, as defined in NFPA 286, shall not occur.
3. The peak rate of heat release throughout the NFPA 286 test shall not exceed 800 kW.
4. The total smoke released throughout the NFPA 286 test shall not exceed 1,000 m².

803.1.3 Room corner test for textile wall coverings and expanded vinyl wall coverings. Textile wall coverings and expanded vinyl wall coverings shall meet the criteria of Section 803.1.3.1 when tested in the manner intended for use in accordance with the Method B protocol of NFPA 265 using the product-mounting system, including adhesive.

803.1.3.1 Acceptance criteria for NFPA 265. During the 40 kW exposure the *interior finish* shall comply with Item 1. During the 150 kW exposure, the *interior finish* shall comply with Item 2. During the entire test, the *interior finish* shall comply with Item 3.

1. During the 40 kW exposure, flames shall not spread to the ceiling.
2. During the 150 kW exposure, the *interior finish* shall comply with the following:
 - 2.1. Flame shall not spread to the outer extremities of the samples on the 8-foot by 12-foot (203 mm by 305 mm) walls.
 - 2.2. Flashover, as described in NFPA 265, shall not occur.
3. The total smoke released throughout the NFPA 265 test shall not exceed 1,000 m².

803.1.4 Acceptance criteria for textile and expanded vinyl wall or ceiling coverings tested to ASTM E 84 or

UL 723. Textile wall and ceiling coverings and expanded vinyl wall and ceiling coverings shall have a Class A flame spread index in accordance with ASTM E 84 or UL 723 and be protected by an *automatic sprinkler system* installed in accordance with Section 903.3.1.1 or 903.3.1.2. Test specimen preparation and mounting shall be in accordance with ASTM E 2404.

803.2 Thickness exemption. Materials having a thickness less than 0.036 inch (0.9 mm) applied directly to the surface of walls or ceilings shall not be required to be tested.

803.3 Heavy timber exemption. Exposed portions of structural members complying with the requirements for buildings of Type IV construction in Section 602.4 shall not be subject to *interior finish* requirements.

803.4 Foam plastics. Foam plastics shall not be used as *interior finish* except as provided in Section 2603.9. This section shall apply both to exposed foam plastics and to foam plastics used in conjunction with a textile or vinyl facing or cover.

803.5 Textile wall coverings. Where used as interior wall finish materials, textile wall coverings, including materials having woven or nonwoven, napped, tufted, looped or similar surface and carpet and similar textile materials, shall be tested in the manner intended for use, using the product mounting system, including adhesive, and shall comply with the requirements of Section 803.1.2, 803.1.3 or 803.1.4.

803.6 Textile ceiling coverings. Where used as interior ceiling finish materials, textile ceiling coverings, including materials having woven or nonwoven, napped, tufted, looped or similar surface and carpet and similar textile materials, shall be tested in the manner intended for use, using the product mounting system, including adhesive, and shall comply with the requirements of Section 803.1.2 or 803.1.4.

803.7 Expanded vinyl wall coverings. Where used as interior wall finish materials, expanded vinyl wall coverings shall be tested in the manner intended for use, using the product mounting system, including adhesive, and shall comply with the requirements of Section 803.1.2, 803.1.3 or 803.1.4.

803.8 Expanded vinyl ceiling coverings. Where used as interior ceiling finish materials, expanded vinyl ceiling coverings shall be tested in the manner intended for use, using the product mounting system, including adhesive, and shall comply with the requirements of Section 803.1.2 or 803.1.4.

803.9 Interior finish requirements based on group. *Interior wall and ceiling finish* shall have a flame spread index not greater than that specified in Table 803.9 for the group and location designated. *Interior wall and ceiling finish* materials tested in accordance with NFPA 286 and meeting the acceptance criteria of Section 803.1.2.1, shall be permitted to be used where a Class A classification in accordance with ASTM E 84 or UL 723 is required.

803.10 Stability. *Interior finish* materials regulated by this chapter shall be applied or otherwise fastened in such a manner that such materials will not readily become detached where subjected to room temperatures of 200°F (93°C) for not less than 30 minutes.

**TABLE 803.9
INTERIOR WALL AND CEILING FINISH REQUIREMENTS BY OCCUPANCY***

GROUP	SPRINKLERED ^l			NONSPRINKLERED		
	Exit enclosures and exit passageways ^{a, b}	Corridors	Rooms and enclosed spaces ^c	Exit enclosures and exit passageways ^{a, b}	Corridors	Rooms and enclosed spaces ^c
A-1 & A-2	B	B	C	A	A ^d	B ^e
A-3 ^f , A-4, A-5	B	B	C	A	A ^d	C
B, E, M, R-1	B	C	C	A	B	C
R-4	B	C	C	A	B	B
F	C	C	C	B	C	C
H	B	B	C ^g	A	A	B
I-1	B	C	C	A	B	B
I-2	B	B	B ^{h, i}	A	A	B
I-3	A	A ^j	C	A	A	B
I-4	B	B	B ^{h, i}	A	A	B
R-2	C	C	C	B	B	C
R-3	C	C	C	C	C	C
S	C	C	C	B	B	C
U	No restrictions			No restrictions		

For SI: 1 inch = 25.4 mm, 1 square foot = 0.0929m².

- a. Class C interior finish materials shall be permitted for wainscotting or paneling of not more than 1,000 square feet of applied surface area in the grade lobby where applied directly to a noncombustible base or over furring strips applied to a noncombustible base and fireblocked as required by Section 803.11.1.
- b. In exit enclosures of buildings less than three stories above grade plane of other than Group I-3, Class B interior finish for nonsprinklered buildings and Class C interior finish for sprinklered buildings shall be permitted.
- c. Requirements for rooms and enclosed spaces shall be based upon spaces enclosed by partitions. Where a fire-resistance rating is required for structural elements, the enclosing partitions shall extend from the floor to the ceiling. Partitions that do not comply with this shall be considered enclosing spaces and the rooms or spaces on both sides shall be considered one. In determining the applicable requirements for rooms and enclosed spaces, the specific occupancy thereof shall be the governing factor regardless of the group classification of the building or structure.
- d. Lobby areas in Group A-1, A-2 and A-3 occupancies shall not be less than Class B materials.
- e. Class C interior finish materials shall be permitted in places of assembly with an occupant load of 300 persons or less.
- f. For places of religious worship, wood used for ornamental purposes, trusses, paneling or chancel furnishing shall be permitted.
- g. Class B material is required where the building exceeds two stories.
- h. Class C interior finish materials shall be permitted in administrative spaces.
- i. Class C interior finish materials shall be permitted in rooms with a capacity of four persons or less.
- j. Class B materials shall be permitted as wainscotting extending not more than 48 inches above the finished floor in corridors.
- k. Finish materials as provided for in other sections of this code.
- l. Applies when the exit enclosures, exit passageways, corridors or rooms and enclosed spaces are protected by an automatic sprinkler system installed in accordance with Section 903.3.1.1 or 903.3.1.2.

803.11 Application of interior finish materials to fire-resistance-rated structural elements. Where *interior finish* materials are applied on walls, ceilings or structural elements required to have a *fire-resistance rating* or to be of noncombustible construction, they shall comply with the provisions of this section.

803.11.1 Direct attachment and furred construction.

Where walls and ceilings are required by any provision in this code to be of fire-resistance-rated or noncombustible construction, the *interior finish* material shall be applied directly against such construction or to furring strips not exceeding 1³/₄ inches (44 mm) applied directly against such surfaces. The intervening spaces between such furring strips shall comply with one of the following:

- 1. Be filled with material that is inorganic or noncombustible;

- 2. Be filled with material that meets the requirements of a Class A material in accordance with Section 803.1.1 or 803.1.2; or
- 3. Be fireblocked at a maximum of 8 feet (2438 mm) in any direction in accordance with Section 717.

803.11.2 Set-out construction. Where walls and ceilings are required to be of fire-resistance-rated or noncombustible construction and walls are set out or ceilings are dropped distances greater than specified in Section 803.11.1, Class A finish materials, in accordance with Section 803.1.1 or 803.1.2, shall be used except where *interior finish* materials are protected on both sides by an *automatic sprinkler system* in accordance with Section 903.3.1.1 or 903.3.1.2, or attached to noncombustible backing or furring strips installed as specified in Section 803.11.1. The hangers and assembly members of such dropped ceilings that are below

INTERIOR FINISHES

the main ceiling line shall be of noncombustible materials, except that in Types III and V construction, *fire-retardant-treated wood* shall be permitted. The construction of each set-out wall shall be of fire-resistance-rated construction as required elsewhere in this code.

803.11.3 Heavy timber construction. Wall and ceiling finishes of all classes as permitted in this chapter that are installed directly against the wood decking or planking of Type IV construction or to wood furring strips applied directly to the wood decking or planking shall be fireblocked as specified in Section 803.11.1.

803.11.4 Materials. An interior wall or ceiling finish that is not more than $\frac{1}{4}$ inch (6.4 mm) thick shall be applied directly against a noncombustible backing.

Exceptions:

1. Noncombustible materials.
2. Materials where the qualifying tests were made with the material suspended or furred out from the noncombustible backing.

803.12 High-density polyethylene (HDPE). Where high-density polyethylene is used as an *interior finish*, it shall comply with the requirements of Section 803.1.2.

803.13 Site-fabricated stretch systems. Where used as interior wall or interior ceiling finish materials, site-fabricated stretch systems shall be tested in the manner intended for use, and shall comply with the requirements of Section 803.1.1 or 803.1.2. If the materials are tested in accordance with ASTM E 84 or UL 723, specimen preparation and mounting shall be in accordance with ASTM E 2573.

SECTION 804 INTERIOR FLOOR FINISH

804.1 General. *Interior floor finish* and floor covering materials shall comply with Sections 804.2 through 804.4.1.

Exception: Floor finishes and coverings of a traditional type, such as wood, vinyl, linoleum or terrazzo, and resilient floor covering materials that are not comprised of fibers.

804.2 Classification. *Interior floor finish* and floor covering materials required by Section 804.4.1 to be of Class I or II materials shall be classified in accordance with NFPA 253. The classification referred to herein corresponds to the classifications determined by NFPA 253 as follows: Class I, 0.45 watts/cm² or greater; Class II, 0.22 watts/cm² or greater.

804.3 Testing and identification. *Interior floor finish* and floor covering materials shall be tested by an agency in accordance with NFPA 253 and identified by a hang tag or other suitable method so as to identify the manufacturer or supplier and style, and shall indicate the *interior floor finish* or floor covering classification according to Section 804.2. Carpet-type floor coverings shall be tested as proposed for use, including underlayment. Test reports confirming the information provided in the manufacturer's product identification shall be furnished to the building official upon request.

804.4 Interior floor finish requirements. In all occupancies, *interior floor finish* and floor covering materials in *exit* enclo-

tures, *exit* passageways, corridors and rooms or spaces not separated from corridors by full-height partitions extending from the floor to the underside of the ceiling shall withstand a minimum critical radiant flux as specified in Section 804.4.1.

804.4.1 Minimum critical radiant flux. *Interior floor finish* and floor covering materials in *exit* enclosures, *exit* passageways and corridors shall not be less than Class I in Groups I-1, I-2 and I-3 and not less than Class II in Groups A, B, E, H, I-4, M, R-1, R-2 and S. In all areas, floor covering materials shall comply with the DOCFF-1 "pill test" (CPS 16 CFR, Part 1630).

Exception: Where a building is equipped throughout with an *automatic sprinkler system* in accordance with Section 903.3.1.1 or 903.3.1.2, Class II materials are permitted in any area where Class I materials are required, and materials complying with the DOC FF-1 "pill test" (CPS 16 CFR, Part 1630) are permitted in any area where Class II materials are required.

SECTION 805 COMBUSTIBLE MATERIALS IN TYPES I AND II CONSTRUCTION

805.1 Application. Combustible materials installed on or embedded in floors of buildings of Type I or II construction shall comply with Sections 805.1.1 through 805.1.3.

Exception: Stages and platforms constructed in accordance with Sections 410.3 and 410.4, respectively.

805.1.1 Subfloor construction. Floor sleepers, bucks and nailing blocks shall not be constructed of combustible materials, unless the space between the fire-resistance-rated floor assembly and the flooring is either solidly filled with noncombustible materials or fireblocked in accordance with Section 717, and provided that such open spaces shall not extend under or through permanent partitions or walls.

805.1.2 Wood finish flooring. Wood finish flooring is permitted to be attached directly to the embedded or fireblocked wood sleepers and shall be permitted where cemented directly to the top surface of fire-resistance-rated floor assemblies or directly to a wood subfloor attached to sleepers as provided for in Section 805.1.1.

805.1.3 Insulating boards. Combustible insulating boards not more than $\frac{1}{2}$ inch (12.7 mm) thick and covered with finish flooring are permitted where attached directly to a noncombustible floor assembly or to wood subflooring attached to sleepers as provided for in Section 805.1.1.

[F] SECTION 806 DECORATIVE MATERIALS AND TRIM

[F] 806.1 General requirements. In occupancies in Groups A, E, I and R-1 and dormitories in Group R-2, curtains, draperies, hangings and other *decorative materials* suspended from walls or ceilings shall meet the flame propagation performance criteria of NFPA 701 in accordance with Section 806.2 or be noncombustible.

25 §2447-B. FOAM PLASTIC INSULATION STANDARDS

25 §2447-B. FOAM PLASTIC INSULATION STANDARDS

1. Prohibition. No individual, partnership or corporation shall install in this State any type of foam plastic insulation unless that product complies with and is installed in accordance with the following requirements.

A. Unless otherwise excepted in the following subparagraphs, all foam plastic or foam plastic cores of manufactured assemblies shall have a flame-spread rating of not more than 75 and a smoke-developed rating of not more than 450 when tested in the maximum thickness intended for use in accordance with ASTM E-84. For all such installations, the foam plastic shall be separated from habitable or occupiable spaces by an approved thermal barrier of 1/2 inch gypsum wallboard or equivalent thermal barrier material which will limit the average temperature rise of the unexposed surface to not more than 250° F. after 15 minutes of fire exposure complying with the ASTM E-119 standard time-temperature curve. Thermal barriers shall be installed in a manner that assures they will stay in place for a minimum of 15 minutes under the same test exposure conditions.

(1) Foam plastics may be used without the thermal barrier described in this paragraph when the foam plastic is protected by a minimum of one inch thickness of masonry or concrete.

(2) Foam plastics when tested in a thickness of 4 inches may be used in a thickness up to 10 inches when the building is equipped with an approved automatic fire suppression system.

For use in rooms within buildings, this requirement shall apply to both the room and that part of the building in which the room is located.

(3) Foam plastics having a maximum flame-spread rating of 75 may be used in thicknesses up to 4 inches in free-standing walk-in coolers or freezer units less than 400 square feet in floor area without a thermal barrier and without an automatic fire suppression system when the foam plastic is covered by a metal facing not less than 0.032 inch thick aluminum or No. 26 gauge steel. When protected by a thermal barrier, the foam plastic may be used in thicknesses up to 10 inches.

(4) Foam plastic insulation having a flame spread of 25 or less may be used in a thickness of not more than 4 inches without the thermal barrier when the foam plastic is covered by a metal facing not less than 0.032 inch thick aluminum or No. 26 gauge steel and the building is provided with an automatic fire suppression system.

(5) Foam plastic may be used in a roof covering assembly without the thermal barrier when the foam is separated from the interior of the building by plywood sheathing not less than 1/2 inch in thickness bonded with interior glue, with edges supported by blocking, tongue-and-groove joints or other approved type of edge support, or an equivalent material.

Foam plastic roof insulation that complies with Factory Mutual Standard 4450 or Underwriters Laboratories Subject 1256 need not meet the requirements of this paragraph.

For roofing applications, the smoke-developed rating shall not be limited.

(6) Foam plastics having a flame-spread rating of 75 or less may be used as a core material without a thermal barrier when the door is covered by a metal facing of not less than 0.032 inch thick aluminum or No. 26 gauge steel.

(7) Foam plastics may be used as a siding backer board with a maximum thickness of 1/2 inch, provided it is separated from the interior of the building by not less than 2 inches of mineral fiber insulation or equivalent, or when applied as siding over existing wall construction.

(8) Within an attic or crawl space where entry is made only for service of utilities, foam plastics shall be protected against ignition by 1 1/2 inch thick mineral fiber insulation, 1/4 inch thick plywood, particleboard, hardboard or gypsum wallboard, No. 26 gauge sheet steel or other approved material installed in such a manner that the foam plastic is not exposed. [1991, c. 2, §96 (COR) .]

B. Existing low hazard storage facilities with foam plastic insulation may be maintained without the required thermal barrier.

(1) Potato storage facilities constructed after the effective date of this paragraph shall provide an approved thermal barrier over foam plastic insulation for a minimum of 8' above the floor.

(2) The State Fire Marshal may permit in specific circumstances the use of foam plastic with a flame barrier when such use does not create a life safety hazard. [1981, c. 101, (NEW) .]

[1991, c. 2, §96 (COR) .]

2. Alternate installations. Foam plastics may be used in applications other than as listed in this section, when specifically approved by the State Fire Marshal based on diversified tests such as the Factory Mutual Building Corner Test Procedure or the enclosed room test procedures described in Underwriters Laboratories Subject 723. These approvals shall also be based on tests conducted in accordance with ASTM E-84 and ASTM D1929. Testing shall be performed on the finished manufactured foam plastic assemblies and on the maximum thickness intended for use.

[1979, c. 167, (NEW) .]

3. Penalty. Any violation of this section shall be a Class E crime.

[1979, c. 167, (NEW) .]

SECTION HISTORY

1979, c. 167, (NEW) . 1981, c. 101, (AMD) . RR 1991, c. 2, §96 (COR) .

The State of Maine claims a copyright in its codified statutes. If you intend to republish this material, we require that you include the following disclaimer in your publication:

All copyrights and other rights to statutory text are reserved by the State of Maine. The text included in this publication reflects changes made through the First Special Session of the 125th Maine Legislature, is current through December 31, 2011, and is subject to change without notice. It is a version that has not been officially certified by the Secretary of State. Refer to the Maine Revised Statutes Annotated and supplements for certified text.

The Office of the Revisor of Statutes also requests that you send us one copy of any statutory publication you may produce. Our goal is not to restrict publishing activity, but to keep track of who is publishing what, to identify any needless duplication and to preserve the State's copyright rights.

PLEASE NOTE: The Revisor's Office cannot perform research for or provide legal advice or interpretation of Maine law to the public. If you need legal assistance, please contact a qualified attorney.
--



STATE OF MAINE
Department of Public Safety
Office of State Fire Marshal
52 State House Station
Augusta, ME 04333-0052

PAUL R. LePAGE
GOVERNOR

JOHN E. MORRIS
COMMISSIONER

JOSEPH THOMAS
STATE FIRE MARSHAL

November 18, 2013

Memo

To: All Public Safety Inspectors

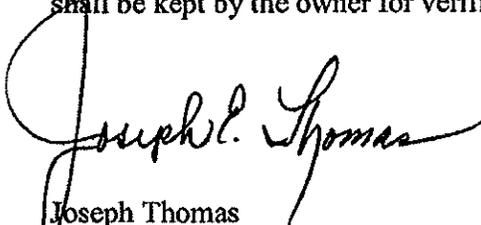
From: Joseph Thomas

Re: Thermal barriers over rigid foam

This memo is to clarify the position of this office regarding the 15 minute thermal barrier required to be installed over foam insulation to separate the foam from habitable and occupiable spaces. Title 25 section 2447-B allows for ½" gypsum wallboard or equivalent to be installed to obtain this thermal barrier. At this time this office will recognize the following products as having achieved equivalency and may be installed without the need of any additional barriers.

1. Thermax Sheathing complying with ASTM C 1289
2. Thermax White Finish complying with ASTM C 1289
3. RMax TSX-8500 complying with ASTM C 1289
4. RMax TSX-8510 Complying with ASTM C 1289

These products can be used if installed as per the manufactures instructions and used within the limitations of testing agency. This list can be amended as more products are tested and evaluated. Installers shall provide property owners a certification of correct installation of these products. A copy of the cut sheet and the certification shall be kept by the owner for verification of compliance


Joseph Thomas
State Fire Marshal

PREVENTION * MITIGATION/ SUPPRESSION * LAW ENFORCEMENT

OFFICES LOCATED AT: 45 COMMERCE DRIVE, AUGUSTA, MAINE 04330

(207) 626-3870 ADMINISTRATION/ INVESTIGATIONS
(207) 626-3880 INSPECTIONS/ PLANS REVIEW

(207) 287-3659 TDD

(207) 287-6251 FAX



STATE OF MAINE
Department of Public Safety
Office of State Fire Marshal
52 State House Station
Augusta, ME 04333-0052

PAUL R. LEPAGE
GOVERNOR

JOHN E. MORRIS
COMMISSIONER

JOHN C. DEAN
STATE FIRE MARSHAL

January 17, 2012

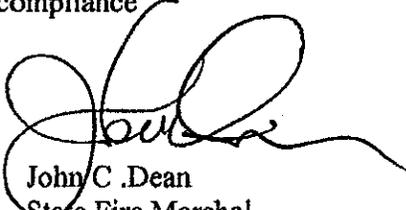
Memo

To: All Public Safety Inspectors
From: John Dean
Re: Thermal barriers over rigid foam

This memo is to clarify the position of this office regarding the 15 minute thermal barrier required to be installed over foam insulation to separate the foam from habitable and occupiable spaces. Title 25 section 2447-B allows for ½" gypsum wallboard or equivalent to be installed to obtain this thermal barrier. At this time this office will recognize the following products as having achieved equivalency and may be installed without the need of any additional barriers.

1. Thermax Sheathing complying with ASTM C 1289 Type 1 Class 2.
2. Thermax White Finish complying with ASTM C 1289 Type 1 Class2

These products can be used if installed as per the manufactures instructions. This list can be amended as more products are tested and evaluated . Installers shall provide property owners a certification of correct installation of these products . A copy of the cut sheet and the certification shall be kept by the owner for verification of compliance



John C. Dean
State Fire Marshal

PREVENTION * MITIGATION/SUPPRESSION * LAW ENFORCEMENT

OFFICES LOCATED AT: 500 CIVIC CENTER DRIVE, AUGUSTA, MAINE 04330
(207) 626-3870 ADMINISTRATION/ INVESTIGATIONS (207) 287-3659 TDD
(207) 626-3880 INSPECTIONS/ PLANS REVIEW

(207) 287-6251 FAX



STATE OF MAINE
Department of Public Safety
Office of State Fire Marshal
52 State House Station
Augusta, ME 04333-0052

PAUL R. LEPAGE
GOVERNOR

JOHN E. MORRIS
COMMISSIONER

JOHN C. DEAN
STATE FIRE MARSHAL

January 17, 2012

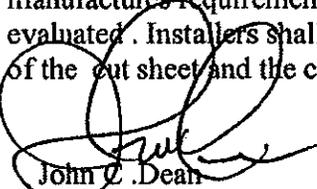
Memo

To: All Public Safety Inspectors
From: John Dean
Re: Ignition barriers over spray foam

This memo is to clarify the position of this office regarding the installation of an ignition barrier over foam plastic insulation within an attic or crawl space where entry is made only for the service of utilities. The foam plastic insulation shall be protected against ignition by 1 1/2" thick mineral fiber insulation, 1/4" plywood, particleboard, hardboard or gypsum wallboard, No. 26 gauge sheet steel or other approved material installed in such a manner that the foam plastic is not exposed. At this time this office will recognize the following products as having achieved equivalency to satisfy this requirement.

1. Cafco TB-415
2. Cafco TB-15
3. Flame Seal TB
4. Flame Control 5050A
5. TPR 2 Fireshell 1B
6. TPR 2 Fireshell F10E
7. TPR 2 Fireshell F1 E
8. International Fireproof Technology Inc. DC315
9. BASF Spraycoat 1920
10. Bayseal IC

These products can be used if installed as per the manufactures instructions, this also includes following the foam manufactures requirements for coating their product. This list can be amended as more products are tested and evaluated. Installers shall provide property owners a certification of correct installation of these products. A copy of the cut sheet and the certification shall be kept by the owner for verification of compliance


John C. Dean
State Fire Marshal

PREVENTION * MITIGATION/SUPPRESSION * LAW ENFORCEMENT

OFFICES LOCATED AT: 500 CIVIC CENTER DRIVE, AUGUSTA, MAINE 04330

(207) 626-3870 ADMINISTRATION/ INVESTIGATIONS
(207) 626-3880 INSPECTIONS/ PLANS REVIEW

(207) 287-3659 TDD

(207) 287-6251 FAX



STATE OF MAINE
Department of Public Safety
Office of State Fire Marshal
52 State House Station
Augusta, ME 04333-0052

PAUL R. LEPAGE
GOVERNOR

JOHN E. MORRIS
COMMISSIONER

JOHN C. DEAN
STATE FIRE MARSHAL

January 17, 2012

Memo

To: All Public Safety Inspectors
From: John Dean
Re: Thermal barriers over spray foam

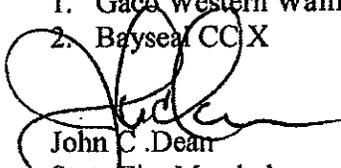
This memo is to clarify the position of this office regarding the 15 minute thermal barrier required to be installed over spray foam insulation to separate the foam from habitable and occupiable spaces. Title 25 section 2447-B allows for ½" gypsum wallboard or equivalent to be installed to obtain this thermal barrier. At this time this office will recognize the following products as having achieved equivalency.

1. Cafco TB-415
2. Cafco TB-15
3. Flame Seal TB
4. TPR 2 Fireshell F10E
5. TPR 2 Fireshell F 1 E
6. International Fireproof Technology Inc. DC 315

These products can be used if installed as per the manufactures instructions, this also includes following the foam manufactures requirements for coating their product. This list can be amended as more products are tested and evaluated. Installers shall provide property owners a certification of correct installation of these products. A copy of the cut sheet and the certification shall be kept by the owner for verification of compliance

The following products may be used within an attic or crawl space where entry is only made for servicing of utilities without an ignition barrier as provided for by the above named statute

1. Gaco Western Wallfoam 183
2. Bayseal CCX


John C. Dean
State Fire Marshal

PREVENTION * MITIGATION/SUPPRESSION * LAW ENFORCEMENT

OFFICES LOCATED AT: 500 CIVIC CENTER DRIVE, AUGUSTA, MAINE 04330
(207) 626-3870 ADMINISTRATION/ INVESTIGATIONS (207) 287-3659 TDD
(207) 626-3880 INSPECTIONS/ PLANS REVIEW

(207) 287-6251 FAX