

Objectives

- Upon completion, participants will be better able to:
 - Identify the key differences between the 2009 IRC, 2012 IRC, and the 2015 IRC.
 - Explain the differences between the current and previous editions.
 - Apply the code requirements for design, plan review and inspection.



Description


- This seminar will assist participants in implementing the transition from the 2009 IRC to the 2015 IRC.
- It will include relevant changes in the 2012 IRC. This interactive training will focus on the key changes presented in the participant material.
- Knowledge review questions will provide opportunity for participants to discuss and consider the changes.



Welcome

- Rules for the course, breaks, restroom location.
- Introduction of instructor and participants.
- Other



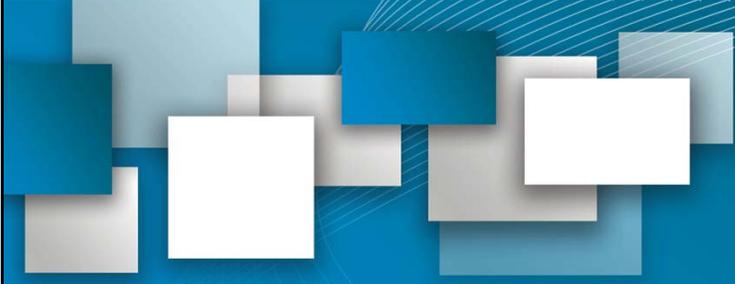

Part 1
**Scope and Administration
(Chapter 1)**

5

R104.11 Alternative Materials, Design, and Methods of Construction and Equipment 2015

- When proposed alternatives are not approved, the reason for the disapproval must be stated in writing by the building official.



2015 IRC Transition from the 2009 IRC

7

R 101.2 2015

Scope – Accessory Structures

- The maximum height for accessory structures has been increased from two to three stories above grade plane. Technical requirements have been removed from the definition, and accessory structures are now permitted to be unlimited in area.



2015 IRC Transition from the 2009 IRC

6

R105.2 2012

Fences Exempt from Permit

- Fences up to 7 feet high are exempt from permit requirements



2015 IRC Transition from the 2009 IRC

8

R105.3.1.1 Existing Buildings ²⁰¹⁵ in Flood Hazard Areas

- Determination of substantial improvement for existing buildings in flood hazard areas is the responsibility of the building official. The related provisions are now consolidated in Section R105.3.1.1.



Activity

- The reason for the disapproval of proposed alternatives must be stated in writing by the building official

True **False**



R106.1.4 Information for ²⁰¹⁵ Construction in Flood Hazard Areas


- Construction documents for dwellings in Coastal A Zones shall include the elevation of the bottom of the lowest horizontal structural member.



Discussion

- The changes in Part 1 Scope and Administration will affect their job responsibilities.



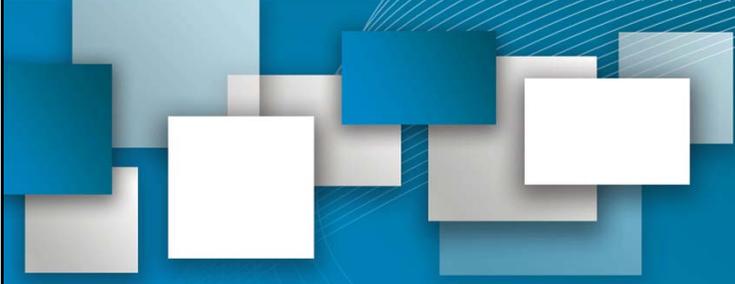

Part 2
**Building Planning
(Chapter 3)**

13

Wind Design Criteria

2012 IRC	2015 IRC
R301.2.1	R301.2
A new map indicates the geographic locations that require wind design, which means an engineered design in accordance with the IBC or ASCE 7, or a design in accordance with the applicable provisions of ICC-600, the WFCM, or AISI S230.	Ultimate design wind speed values replace basic wind speed values for 3-sec gust wind speeds in Section R301.2.2. A wind speed conversion table has been added for conversion from ultimate design to nominal design wind speeds



2015 IRC Transition from the 2009 IRC

15

Table R301.2(1) Climatic and Geographic Design Criteria

2015

- The jurisdiction must indicate if it contains special wind regions or wind borne debris zones

TABLE R301.2(1) Climatic and Geographic Design Criteria

Ground Snow Load	Wind Design			Seismic Design Category ^f
	Speed ^d (Mph)	Topographic effects ^k	Special wind region ^l	

(Portions of table and footnotes not shown remain unchanged)

^l In accordance with Figure R301.2(4)A, where there is local historical data documenting unusual wind conditions, the jurisdiction shall fill in this part of the table with "YES" and identify any specific requirements. Otherwise, the jurisdiction shall indicate "NO" in this part of the table.

^m In accordance with Section R301.2.1.2.1, the jurisdiction shall indicate the wind-borne debris wind zone(s). Otherwise, the jurisdiction shall indicate "NO" in this part of the table.



2015 IRC Transition from the 2009 IRC

14

R301.2.1.1.1 Sunrooms

2015

- The 2015 IRC requires sunrooms to comply with AAMA/NPEA/NSA 2100-12. The standard contains requirements for habitable and non-habitable sunrooms.




2015 IRC Transition from the 2009 IRC

16

2015

R301.2.1.2 Protection of Openings in Wind Borne Debris Regions

- The mean roof height limit has been increased from 33 feet to 45 feet for the prescriptive attachment provisions for wood structural panels protecting glazing. The ASTM E 1996 standard has been modified to classify wind zones according to ultimate design wind speed.



2015 IRC Transition from the 2009 IRC

17

2015

R301.2.4 Floodplain Construction

- Buildings located in a flood hazard area must comply with the provisions for the most restrictive flood hazard area and may use ASCE 24 for design.



2015 IRC Transition from the 2009 IRC

19

2015

R301.2.1.4 Wind Exposure Category

- Wind Exposure Category A has been deleted because it no longer exists in the IBC and ASEC 7, which is the basis for determination of wind exposure categories. Wind Exposure Category D now applies to open water, mud and salt flats, and unbroken ice fields, which includes hurricane-prone regions.



2015 IRC Transition from the 2009 IRC

18

2015

R301.3 Story Height

- Story height of wood and steel wall framing, insulated concrete, and SIP walls may not exceed 11ft, 7in. Masonry wall height is limited to 13ft 7in.



2015 IRC Transition from the 2009 IRC

20

Exterior Walls

2012 IRC	2015 IRC
R302.1	R302.1
The minimum clearances to lot lines have been reduced from 5 feet to 3 feet for unrated exterior walls when the dwelling is protected with a fire sprinkler system. The code now permits construction of unrated exterior walls on the lot line when all dwellings in the subdivision are protected with automatic fire sprinkler systems and the opposing lot maintains a minimum 6-foot clearance from the common lot line.	Unprotected roof overhangs are now permitted to project to within 2ft of the property line when fireblocking is installed between the top of the wall and the roof sheathing. In most cases, projections are not permitted less than 2ft from the property line. For dwellings with or without fire sprinkler protection, penetrations of exterior walls do not require fire-resistant protection unless they are located less than 3ft from the property line.




Townhouse Separation R302.2.2 Parapet Exception

2012 IRC	2015 IRC
R302.2	R302.2
When a parapet is not installed, openings and penetrations of the roof are no longer permitted within 4 feet of the separating wall between townhouse dwelling units	The provisions for separating townhouses with structurally independent fire-resistant-rated walls in accordance with Section R302.1 have been removed in favor of the common wall provisions of Section R302.2. Common walls separating townhouses must now be rated for 2hrs when an automatic fire sprinkler system is not installed in the townhouse dwelling units.



R302.1 Exterior Walls


2015

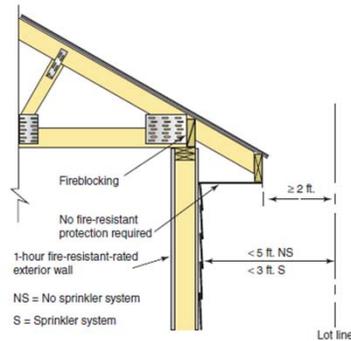

Fire resistance rating is not required for roof eave projections when fireblocking is installed.



Townhouse Separation R302.2.2 Parapet Exception

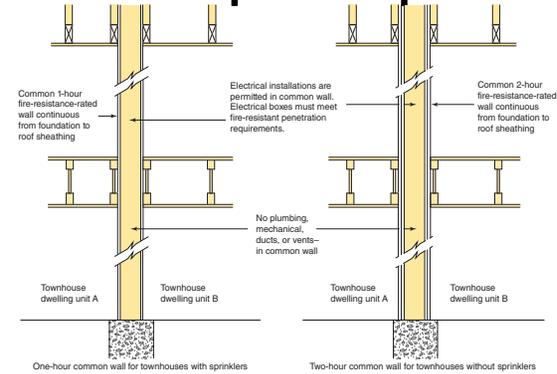

Townhouse Separation

R302.2.2 Parapet Exception

2012

Townhouse Unit A Townhouse Unit B

No roof openings or penetrations within 4 feet of the townhouse separation are allowed when using the exception to the parapet provisions.

2015 IRC Transition from the 2009 IRC 25

Fire Protection of Floors

2015

2012 IRC	2015 IRC
R302.13 (R501.3)	R302.13
With some exceptions, the code now requires 1/2-inch gypsum board or equivalent material to be applied to the underside of floor assemblies in buildings regulated by the IRC.	The provisions for fire protection of floors have been relocated from Chapter 5 to the fire-resistant construction provisions of Section R302. New language clarifies that the code does not regulate penetrations or openings in the fire protection membrane.

2015 IRC Transition from the 2009 IRC 27

R302.5.1

Garage Opening Protection

2012

- Doors between the garage and dwelling unit now require self-closing devices.

2015 IRC Transition from the 2009 IRC 26

R302.13

Fire Protection of Floors

2015

Fire protection of floors

2015 IRC Transition from the 2009 IRC 28

R303 2012
Mechanical Ventilation

- When used for satisfying the ventilation requirements for dwellings, mechanical ventilation must now comply with new provisions in Section M1507 for whole-house ventilation of habitable rooms and local exhaust of bathrooms. A whole-house mechanical ventilation system is now required for any dwelling that is tested with a blower door test and determined to have an air infiltration rate of less than 5 air changes per hour. Definitions for whole-house mechanical ventilation system and local exhaust have been added to Section R202



2015 IRC Transition from the 2009 IRC 29

R303.7, R303.8 2015
Stairway Illumination

- Interior and exterior stairway illumination provisions have been placed in separate sections. Conflicting language has been removed to clarify the requirements.



2015 IRC Transition from the 2009 IRC 31

R303.5 2012
Ventilation Intake Openings

- The minimum vertical clearance between a contaminant source and an outdoor air intake below has increased from 2 feet to 3 feet.



2015 IRC Transition from the 2009 IRC 30

R304.1 2015
Minimum Habitable Room Area

- The requirement for one habitable room with a minimum floor area of 120sf has been removed from the code.



2015 IRC Transition from the 2009 IRC 32

R305 2015
Ceiling Height


- The minimum ceiling height for bathrooms, toilet rooms, and laundry rooms has been reduced to 6ft 8in. The exception for allowing beams, girders, ducts or other obstructions to project to within 6ft 4in of the finished floor has been expanded to include basement with habitable space.



2015 IRC Transition from the 2009 IRC 33

R308.4.2 2015
Glazing Adjacent to Doors

- Glazing installed perpendicular to a door in a closed position and within 24in of the door only requires safety glazing if it is on the hinge side of an in-swinging door.

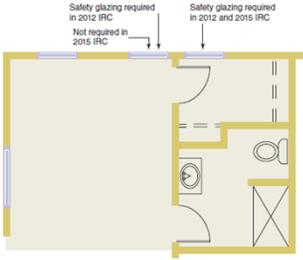


2015 IRC Transition from the 2009 IRC 35

R308.4 2012
Hazardous Locations for Glazing

- The provisions for hazardous locations related to the installation of glazing have been reorganized for ease of use and consistent application. Each item in the numbered list of hazardous locations has been placed in a separate subsection and given a descriptive title.



2015 IRC Transition from the 2009 IRC 34

Glazing and Wet Surfaces

2012 IRC	2015 IRC
R308.4.5	R308.4.5
The separate provisions regulating glazing near tubs and swimming pools have been consolidated into one subsection titled Glazing and Wet Surfaces.	The exception from the safety glazing requirement for glazing that is 60 in. or greater from the water's edge of a bathtub, hot tub, spa, whirlpool, or swimming pool has been expanded to include glazing that is an equivalent distance from the edge of a shower, sauna, or steam room.




2015 IRC Transition from the 2009 IRC 36

R308.4.6 Glazing Adjacent Stairs and Ramps 2012


- The glazing that is not considered to be in a hazardous location, the rule for the minimum height above a tread at the side of a stairway is now 36 inches to correspond to the height of a guard as previously found in the exception. Other revisions to the test clarify the meaning and application of the glazing requirements at stairways.



R308.4.6 Glazing Adjacent Stairs and Ramps 2012

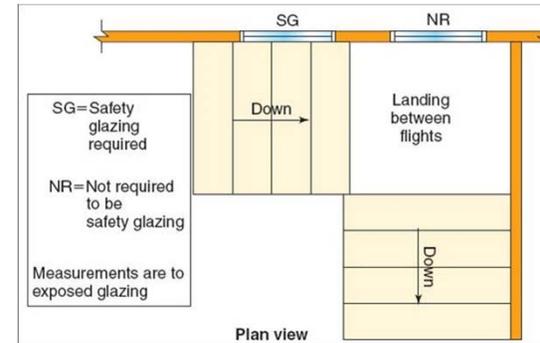

R308.4.6 Glazing Adjacent Stairs and Ramps 2012

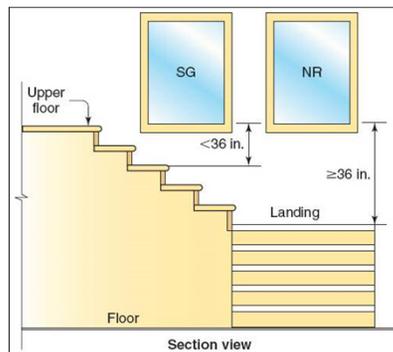

Glazing Adjacent to the Bottom Stair Landing

2015 IRC	2015 IRC
R308.4.7	R308.4.7
The provisions for glazing installed near the landing at the bottom of a stairway have been revised to clarify the application. The threshold for the minimum height above the walking surface is now 36 inches for determining that the glazing is not in a hazardous location.	Glazing adjacent to the bottom stair landing is now defined as the area in front of the plane of the bottom tread.



R309.5 2012
Garage Fire Sprinklers

- In a subdivision where all homes are protected with dwelling fire sprinkler systems, nonrated exterior walls of garages are permitted to be constructed on a lot line when the garage is protected with a fire sprinkler system and meets the other conditions of Section R302.1.



2015 IRC Transition from the 2009 IRC 41

R310.2.2 2012
Window Well Drainage


- Except for locations with well-drained soils, window wells serving emergency escape and rescue openings now require a means to drain surface water to the foundation drainage system.



2015 IRC Transition from the 2009 IRC 43

R310 Emergency Escape and Rescue Openings 2015

- The emergency escape and rescue openings provisions have been reorganized. Separate provisions spell out the requirements for windows and doors used for emergency escape and rescue.



Emergency escape and rescue opening
Typical use of patio doors and windows as emergency escape and rescue openings



2015 IRC Transition from the 2009 IRC 42

R310.5, R310.6 Emergency Escape and Rescue Openings for Additions, Alterations and Repairs 2015

- The basement of a dwelling addition does not require an emergency escape and rescue opening if there is access to a basement that does have an emergency escape and rescue opening. Remodeling of an existing basement does not trigger the emergency escape and rescue opening requirements unless a new bedroom is created.



2015 IRC Transition from the 2009 IRC 44

R311.7.3, R311.7.5.1 Stair Risers

2015

- The total vertical rise in a stairway without an intermediate landing has increased from 144in to 147 in. The provision for allowing open risers has been clarified. It is based on the distance above grade or the floor below, not on the total rise of the stair. A new exception clarifies that open risers are permitted on spiral stairways.



2015 IRC Transition from the 2009 IRC

45

R311.7.10.1 Spiral Stairways

2015

- The code adds a definition of spiral stairway that omits any requirement for a center post to allow for design flexibility. The code now limits the size of spiral stairways by restricting the radius at the walk line to a dimension not greater than 24 ½ ins. The method of measurement for tread depth now matches the winder provisions and measures at the intersection of the walk line and the tread nosing rather than perpendicular to the leading edge of the tread.



2015 IRC Transition from the 2009 IRC

47

R311.7.6 Landing for Stairways

2015

- For a turn in a stairway, the IRC now specifically permits angular and curved stair landing with certain dimensions less than 36 inches if the prescribed depth is provided at the walk line and minimum area criteria are satisfied. The maximum vertical rise requirement of 12 feet has been moved from the exception to a new Section R311.7.3.




2015 IRC Transition from the 2009 IRC

46

R311.7.11, R311.7.12 Alternating Tread Devices and Ship Ladders

2015

- Alternating tread devices and ship ladders have been added to the stair provisions. Neither device is approved for use as a means of egress.



2015 IRC Transition from the 2009 IRC

48

R311.8 Ramps

2015

- Ramps that do not serve the required egress door are now permitted to have a slope not greater than 1 unit vertical in 8 units horizontal.



2015 IRC Transition from the 2009 IRC

49

Window Fall Protection

2012 IRC

R312.2

The provisions for window fall protection have been relocated from Chapter 6 to Chapter 3. The terminology for window opening control devices has been updated for consistency with the referenced standard ASTM F 290. Operation criteria found in the 2008 edition of the standard have been deleted from the prescriptive provisions of the IRC.

2015 IRC

R312.2

The window fall protection provisions have been revised to clarify the meaning, remove redundant language, and achieve consistency with the IBC provisions.



2015 IRC Transition from the 2009 IRC

51

R312.1.2 Guard Height

2015

- The provision requiring that the guard height be measured from the surface of adjacent fixed seating has been removed from the code.



2015 IRC Transition from the 2009 IRC

50

Smoke Alarms

2012 IRC

R314

The code now specifically recognizes wireless technology in lieu of interconnection for smoke alarm installation in both new and existing dwelling units. The interconnection provisions have been moved out of the sections related to location and power source and placed in a new section.

2015 IRC

R314

Battery-operated smoke alarms are permitted for satisfying the smoke alarm power requirements when alternations, repairs, and additions occur. Household fire alarm systems no longer require monitoring by an approved supervising station. New provisions address nuisance alarms related to devices installed near bathrooms and cooking appliances.



2015 IRC Transition from the 2009 IRC

52

Carbon Monoxide Alarms

2012 IRC	2015 IRC
R315	R315
The code now specifically recognizes carbon monoxide detection systems with separate detectors and notification appliances installed in accordance with NFPA 720.	Carbon monoxide alarms now require connection to the house wiring system with battery backup. Exterior work such as roofing, siding, windows, doors, and decks and porch additions no longer trigger the carbon monoxide alarm provisions for existing buildings. An attached garage is one criterion for requiring carbon monoxide alarms, but only if the garage has an opening into the dwelling. A carbon monoxide alarm is required in bedrooms when there is a fuel-fired appliance in the bedroom and adjoining bathroom. Carbon Monoxide detection systems only require detectors installed in the locations prescribed by the code and not those locations described in NFPA 720.

53

2015 IRC Transition from the 2009 IRC

R316.5.13

2015

Thermal Barrier for Floors

- New provisions allow the installation of structural insulated panels and other materials containing foam plastic insulation as part of a floor system without requiring a thermal barrier on the upper surface. The code requires a minimum 1/2-inch wood structural panel or equivalent material to protect the foam plastic insulation.



2015 IRC Transition from the 2009 IRC

55

Thermal Barrier

2012 IRC	2015 IRC
R316.4	R316.4
Reference to a new standard, NFPA 275, replaces references to previous standards for determining an acceptable thermal barrier material other than 1/2-inch gypsum wallboard.	23/32-inch wood structural panels satisfy the thermal barrier requirements for foam plastic insulation.

54



2015 IRC Transition from the 2009 IRC

R322.1, R322.2

2015

Flood Hazards

- Section R322.1 is modified to emphasize that the provision applies to existing buildings in flood hazard areas where 50% or more of the structure has damage and requires restoration. Section R322.2 limits the minimum elevation allowed for dwellings in flood hazard areas and defines a Coastal A Zone.



2015 IRC Transition from the 2009 IRC

56

R322.3

2015

Coastal High-Hazard Areas

- Coastal A Zones are defined and an exception for foundation types in Coastal A Zones is added.



2015 IRC Transition from the 2009 IRC

57

R326 Swimming Pools, Spas and Hot Tubs

2015

- The design and construction of pools and spas shall comply with the International Swimming Pool and Spa Code (ISPSC). Appendix G, Swimming Pools, Spas and Hot Tubs, has been deleted.



2015 IRC Transition from the 2009 IRC

59

R325

2015

Mezzanines

- New provisions place limitations on the construction of mezzanines related to ceiling height and openings consistent with the IBC.



2015 IRC Transition from the 2009 IRC

58



Asking questions for discussion

- The changes in the climate and Geographic Design criteria and how this will affect their job responsibilities.
- The changes in the wind design criteria and how this will affect their job responsibilities.
- .
- .



2015 IRC Transition from the 2009 IRC

60

Compare two things

2012

R302.1 Exterior Wall
R 314 Smoke Alarms

2015

- R 302.1 Exterior walls
- R 314 Smoke Alarms



R403.1.1 Minimum Footing Size

2015

- The table for minimum footing size and thickness is divided into three expanded tables based on the type of construction being supported: light frame, light frame with veneer, and concrete or masonry. The values are also based on the type of foundations: slab on grade, crawl space, or basement.



Part 3
**Building Construction
(Chapters 4-10)**

R403.1.3 Footing and Stem Wall Reinforcing in Seismic Design Categories D₀, D₁, and D₂

2015

- Updated figures and code provisions in Section R403.1.3 now clearly define minimum required reinforcement in footings and stem walls located in Seismic Design Categories (SDC) D₀, D₁, and D₂



R403.1.6

2015

Foundation Anchorage

- Anchor bolts are now required to be placed in the middle third of the sill plate.



2015 IRC Transition from the 2009 IRC

65

R404.1.4.1 Masonry Foundation Walls in SDC D₀, D₁, and D₂

2015

- Minimum vertical reinforcement in masonry stem walls has been increased from No. 3 bars to No. 4 bars spaced in maximum of 4ft on center in grouted cells.



2015 IRC Transition from the 2009 IRC

67

Tables 404.1(1) through R404.1(3) Lateral Support for Concrete and Masonry Foundation Walls

2012

- The tables prescribing lateral restraint at the top of basement foundation walls have been deleted.



2015 IRC Transition from the 2009 IRC

66

R404.1.9 Isolated Masonry Piers

2012

- The IRC now includes prescriptive provisions for the construction of isolated masonry pier foundations supporting raised floor systems



2015 IRC Transition from the 2009 IRC

68

R404.4 2015

Retaining Walls

- Retaining walls, freestanding walls not supported at the top, with more than 48ins of unbalanced backfill must be designed by an engineer. Retaining walls resisting additional lateral loads and with more than 24ins of unbalanced backfill must also be designed in accordance with accepted engineering practice.



2015 IRC Transition from the 2009 IRC 69

Tables R502.3.1(1), R502.3.1(2) Floor Joist 2015

Spans for Common Lumber Species

- Changes to Southern Pine (SP), Douglas Fir-Larch (DFL), and Hemlock Fir (HF) lumber capacities have changed the floor joist span length in the prescriptive tables of the IRC. Span lengths for Southern Pine have decreased: lengths for DFL and HF joists have increased.

2015 IRC Transition from the 2009 IRC 71

R405.1 2012

Foundation Drainage

- A filter membrane is now required for perforated foundation drains.

2015 IRC Transition from the 2009 IRC 70

Tables R502.3.1(1), R502.3.1(2) Floor Joist 2015

Spans for Common Lumber Species

TABLE R502.3.1(1) Floor Joist Spans for Common Lumber Species (Residential sleeping areas.
Live load = 30 psf, L/A = 360f³)

Joist Spacing (inches)	Species and Grade	Dead Load = 10 psf						Dead Load = 20 psf									
		2 x 6		2 x 8		2 x 10		2 x 12		2 x 6		2 x 8		2 x 10		2 x 12	
		(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)
12	Douglas fir-larch SS	12-6	15-6	21-0	25-7	11-6	16-4	21-0	25-7	11-0	14-6	19-0	23-7	11-0	14-6	19-0	23-7
	Douglas fir-larch #1	12-0	15-10	20-3	24-8	12-0	15-7	19-0	22-0	11-0	14-9	18-0	20-11	11-0	14-9	18-0	20-11
	Douglas fir-larch #2	11-10	15-7	19-10	23-4	11-8	14-9	18-0	20-11	11-0	14-6	18-0	20-4	11-0	14-6	18-0	20-4
	Douglas fir-larch #3	9-11	12-7	15-3	17-10	8-11	11-3	13-9	16-0	11-0	14-6	18-0	20-4	11-0	14-6	18-0	20-4
	Hem-fir SS	11-10	15-7	19-10	24-2	11-10	15-7	19-10	24-2	11-0	14-6	18-0	20-4	11-0	14-6	18-0	20-4
	Hem-fir #1	11-7	15-3	19-5	23-7	11-7	15-3	18-9	21-9	11-0	14-6	18-0	20-4	11-0	14-6	18-0	20-4
	Hem-fir #2	11-0	14-6	18-6	22-6	11-0	14-4	17-6	20-4	11-0	14-6	18-0	20-4	11-0	14-6	18-0	20-4
	Hem-fir #3	9-8	12-4	15-0	17-5	8-9	11-0	13-5	15-7	11-0	14-6	18-0	20-4	11-0	14-6	18-0	20-4
	Southern pine SS	12-3	16-2	20-8	25-1	12-3	16-2	20-8	25-1	11-0	14-6	18-0	20-4	11-0	14-6	18-0	20-4
	Southern pine #1	11-10	15-7	19-10	24-2	11-10	15-7	19-10	24-2	11-0	14-6	18-0	20-4	11-0	14-6	18-0	20-4
	Southern pine #2	11-3	14-11	18-1	21-4	10-9	13-8	16-2	19-1	11-0	14-6	18-0	20-4	11-0	14-6	18-0	20-4
	Southern pine #3	9-2	11-6	14-0	16-6	8-2	10-3	12-6	14-9	11-0	14-6	18-0	20-4	11-0	14-6	18-0	20-4
Spruce-pine-fir SS	11-7	15-3	19-5	23-7	11-7	15-3	19-5	23-7	11-0	14-6	18-0	20-4	11-0	14-6	18-0	20-4	
Spruce-pine-fir #1	11-3	14-11	19-0	23-0	11-3	14-7	17-9	20-7	11-0	14-6	18-0	20-4	11-0	14-6	18-0	20-4	
Spruce-pine-fir #2	11-3	14-11	19-0	23-0	11-3	14-7	17-9	20-7	11-0	14-6	18-0	20-4	11-0	14-6	18-0	20-4	
Spruce-pine-fir #3	9-8	12-4	15-0	17-5	8-9	11-0	13-5	15-7	11-0	14-6	18-0	20-4	11-0	14-6	18-0	20-4	

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound per square foot = 0.0479 kPa.
 Note: Check sources for availability of lumber in lengths greater than 20 feet.
 a. Dead load limits for townhouses in Seismic Design Category C and all structures in Seismic Design Categories D, D_s, and D₃ shall be determined in accordance with Section R301.2.2.1.

2015 IRC Transition from the 2009 IRC 72

R502.10

2015

Framing of Floor Openings

- Requirements for header joist and trimmer connections in the framing of floor openings have been deleted. This section conflicted with Section R502.6, which contains minimum bearing lengths for all joists and headers.



2015 IRC Transition from the 2009 IRC


73

R507.2 Deck Ledger

2015

Connection to Band Joist

- The deck ledger section is reorganized to better describe the minimum requirements for connection of deck ledgers to band joists.

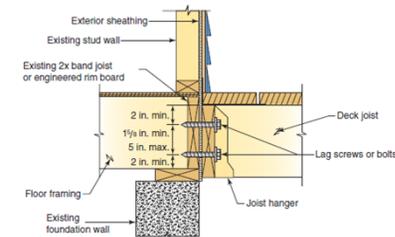

2015 IRC Transition from the 2009 IRC

75

R507 Decks

2012

- All deck provisions have been relocated to a new section.
- The prescriptive provisions related to the placement of bolts and lags for deck ledger attachment to the band joist have been revised to correlate with the National Design Specifications (NDS) for Wood Construction.



2015 IRC Transition from the 2009 IRC

74

R507.2.4 Alternative Deck Lateral Load Connection

2015

- When the prescriptive deck lateral load connection that has appeared in the previous editions of the code is chosen as a design option, the code now requires the two hold-down devices to be within 2 feet of the ends of the deck. A new lateral load connection option prescribes four hold-downs installed below the deck structure.



2015 IRC Transition from the 2009 IRC

76

2015

R507.4 Decking


- The code sets the maximum allowable spacing for deck joists supporting the various types of common decking materials.



2015 IRC Transition from the 2009 IRC 77

2015

R507.5, R507.6, R507.7 Deck Joists and Beams

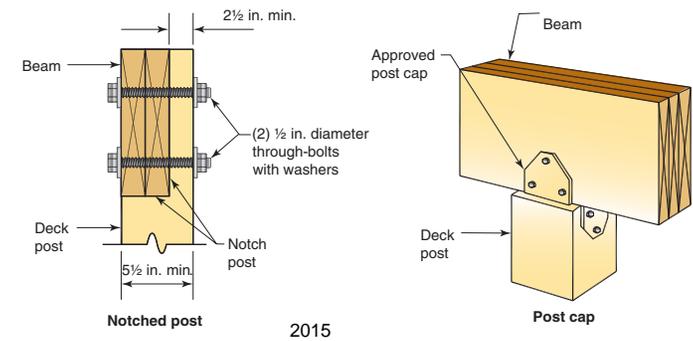

2015



2015 IRC Transition from the 2009 IRC 79

2015

R507.5, R507.6, R507.7 Deck Joists and Beams

- New sections and tables provide prescriptive methods for joists and beams in deck construction. Section R507.5 describes requirements for deck joists, Section R507.6 lists requirements for deck beams, and Section R507.7 describes minimum bearing requirements for joists and beams.




2015 IRC Transition from the 2009 IRC 78

2015

R507.8 Deck Posts

- New Section R507.8 establishes minimum sizes of wood posts supporting wood decks and describes the requirements for connection of deck posts to the footing.

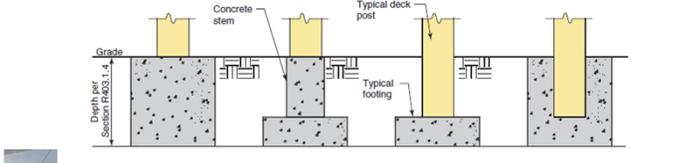


2015 IRC Transition from the 2009 IRC 80

Fastener Schedule for Structural Members

2012 IRC	2015 IRC
Table R602.3(1)	Table R602.3(1)
Table R602.3 (1) now includes requirements for nailing roof trusses to plates, abutting studs at intersecting wall corners, and connection of rim board to sill plates.	The Fastening Schedule now contains multiple nail size options. Roof rafter connections at ridge, valley, and hip are revised. Double top plate splicing is clarified. Clarification of the joist-to-band-joist (rim board) connection is added.



Headers

2012 IRC	2015 IRC
R602.7, Table R602.7.1	R602.7, Tables R602.7(1), R602.7(2), R602.7(3), R602.7.5
The code now includes prescriptive provisions for single member headers under limited conditions.	The girder and header span tables of Chapter 5 have been moved to the header section in Chapter 6, Multiply and single header tables are combined. A new section describing rim board headers is added.



R602.3.1

2015

Stud Size, Height, and Spacing

- Table R602.3.1 is deleted and the exception for walls greater than 10ft tall is added to the text of Section R602.3.1. If studs in a tall wall meet Exception 2, they meet the requirements of the IRC and do not need engineering or use of an alternate standard.



R602.10.1

2012

Braced Wall Lines

- The section has been reorganized to address braced wall lines only, including provisions for spacing and offsets.



R602.10.2 2012

Braced Wall Panels

- Information on braced wall panels has been placed in one section. Braced wall panels now may be located up to 10 feet from both ends of the braced wall line. Maximum braced wall panel spacing is 20 ft. measured edge to edge.



2015 IRC Transition from the 2009 IRC 85

Required Length of Bracing


2015 IRC	2015 IRC
R602.10.3 Information on the required length of wall bracing is consolidated into one section. Wind wall bracing adjustments have been placed in a separate table from the bracing requirements based on wind speed	Table R602.10.3(1) Table values for bracing requirements based on wind speed have changed slightly due to use of ultimate design wind speed values to calculate required bracing length.



2015 IRC Transition from the 2009 IRC 87

R602.10.2 2012

Braced Wall Panels

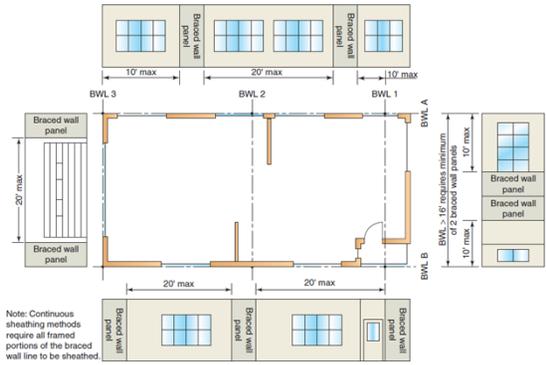

Note: Continuous sheathing methods require all framed portions of the braced wall line to be sheathed.



2015 IRC Transition from the 2009 IRC 86

R602.10.4 Construction 2012

Methods for Braced Wall Panels

- Bracing construction methods and the allowable mixing of bracing methods have been grouped into a single section. Braced wall lines that change from exterior to interior wall lines may now mix bracing methods along the braced wall line.



2015 IRC Transition from the 2009 IRC 88

R602.10.9 2012
Braced Wall Panel Support

- Concrete stem walls 48 inches long or less and that are less than 6 inches thick require reinforcement similar to narrow masonry stem walls for supporting braced wall panels.



2015 IRC Transition from the 2009 IRC 93

Simplified Wall Bracing

2012 IRC	2015 IRC
R602.12	R602.12
This new section offers an alternative method to braced wall lines for detached dwellings located in SDC A, B, C and townhouses in SDC A or B. The code also places limitations on wind speed, exposure category, building size and other criteria.	Simplified wall bracing is now allowed for one-to three-story dwellings and townhouse in Wind Exposure Category B or C with ultimate design wind speeds (V_{ult}) of 130 mph or less.



2015 IRC Transition from the 2009 IRC 95

R602.10.11 2015
Cripple Wall Bracing

- A reduction is no longer required in determining the maximum distance between braced wall panels in a cripple wall. References to the bracing length adjustment tables clarify that increased bracing is required if gypsum wall finish is not applied to the cripple wall.



2015 IRC Transition from the 2009 IRC 94

R603.9.5 Structural Sheathing over Steel Framing for Stone and Masonry Veneer 2015

- Section R603.9.5 addressing the bracing requirements for cold-formed steel framing with stone or masonry veneer has been expanded to include the higher seismic design categories. This section directs the user to increase bracing length when a structure is located in SCD C, D_0 , D_1 , and D_2 and has stone or masonry veneer.



2015 IRC Transition from the 2009 IRC 96

R606.3.5 Grouting Requirements for Masonry Construction 2015

- With reorganization of the masonry wall provisions in the 2015 IRC, the section covering provisions for grouting above-ground masonry walls now combines all the requirements for single, multiwythe, and reinforced masonry construction in one section. Clarified provisions address grout placement, cleanouts, and construction for all three types of masonry construction.



R703.3 Siding Material Thickness and Attachment 2015

- New code language clarifies limitations of use of Table R703.4 and describes fastener type, length, and penetration criteria. Table R703.4, Weather Resistant Siding Attachment and Minimum Thickness, is simplified.



R610.7 Drilling and Notching in Structural Insulated Panels 2015

- Drilling and notching provisions for structural insulated panels (SIP) are clarified.



R703.5 Wood, Hardboard, and Wood Structural Panel Siding 2015

- Minimum spacing based on siding thickness has been moved from 2012 IRC Table R703.4 footnote i, siding attachment and minimum thickness, to 2015 IRC Section R703.5.2, panel siding. Requirements for vertical wood siding have moved from 2012 IRC footnote j to 2015 IRC Section R703.5.1 vertical wood siding.



R703.6 Wood Shakes and Shingles on Exterior Walls 2015

- The provisions for the application of wood shakes and shingles on exterior walls have been reorganized to give more information within tables for ease of use.



2015 IRC Transition from the 2009 IRC

101

R703.7.4 Masonry Veneer Anchorage 2012

- The fastener and air space requirements for anchored veneer have been placed in a new table for ease of use. The veneer tie spacing requirements have been modified for consistency with Building Code Requirements and Specification for Masonry Structures (TMS 402/ACI 530/ASCE 5).



2015 IRC Transition from the 2009 IRC

103

R703.7.3.2 Masonry Veneer Lintel 2012

- Minimum and Maximum heights of masonry veneer are established for masonry lintels spanning not greater than 18 feet 3 inches.



2015 IRC Transition from the 2009 IRC

102

R703.7.4.2 Grout Fill Behind Masonry Veneer 2012

- Mortar is no longer permitted to fill the air space behind anchored masonry veneer.




2015 IRC Transition from the 2009 IRC

104

R703.9 Exterior Insulation and Finish Systems 2015

- Limitations for exterior insulation and finish systems (EIFS) with and without drainage have been added to the 2015 IRC. EIFS with drainage is required over all wall assemblies except concrete and masonry.



2015 IRC Transition from the 2009 IRC

105

R703.12 Adhered Masonry Veneer 2012

- Minimum clearance and flashing requirements have been added to apply to the base of adhered masonry veneer on exterior walls.



2015 IRC Transition from the 2009 IRC

107

R703.11.1 Vinyl Siding Attachment 2015

- This code clarifies nailing penetration and spacing requirements for horizontal and vertical vinyl siding.



2015 IRC Transition from the 2009 IRC

106

R703.13, R703.14 Insulated Vinyl Siding and Polypropylene Siding 2015

- New sections set minimum requirements for insulated vinyl siding and polypropylene siding. Polypropylene siding requires a minimum 5-ft fire separation distance and must maintain 10-ft separation from buildings on other lots.



2015 IRC Transition from the 2009 IRC

108

R703.15, R703.16, R703.17 Cladding Attachment over Foam Sheathing 2015

- Three new sections set minimum requirements for cladding attachment over foam sheathing to wood framing (R703.15), cold-formed steel framing (R703.16), and masonry or concrete walls (R703.17). For light-frame construction, prescriptive requirements are given. Connection to concrete and masonry construction continues to require engineered design in most cases when placing foam over the concrete or masonry wall.



R802.7 Cutting, Drilling, and Notching of Roof Members 2012

- Text in Section R802.7 has been deleted in favor of referencing Section R502.8.1 for provisions related to cutting, drilling, and notching of solid lumber.
- Provisions for notching of cantilevered rafters are placed in a new section, and the nominal dimension is replaced by the actual minimum dimension of 3 1/2 inches for the remaining portion of the rafter.
- A new section clarifies the limits for taper cuts on the ends of ceiling joists.
- Two new figures aid in determine the correct application of cantilevered rafters and ceiling joist taper cut requirements.



Tables R802.4, R802.5 Ceiling Joist and Rafter 2015

- Changes to Southern Pine, Douglas Fir-Larch, and Hemlock Fir capacities have changed the maximum spans for lumber in the ceiling joist and rafter span tables of the IRC.

TABLE R802.4(1) Ceiling Joist Spans for Common Lumber Species (Uninhabitable attics without storage, live load = 10 psf, L/A = 240)

Ceiling Joist Spacing (inches)	Species and Grade	Dead Load = 5 psf			
		2 × 4	2 × 6	2 × 8	2 × 10
		Maximum ceiling joist spans			
		(feet - inches)	(feet - inches)	(feet - inches)	(feet - inches)
16	Douglas fir-larch SS	11-11	18-9	24-8	Note a
	Douglas fir-larch #1	11-6	18-1	23-10	Note a
	Douglas fir-larch #2	11-3	17-8	23-4	Note a
	Douglas fir-larch #3	9-7	14-1	17-10	21-9
	Hem-fir SS	11-3	17-8	23-4	Note a
	Hem-fir #1	11-0	17-4	22-10	Note a
	Hem-fir #2	10-6	16-6	21-9	Note a
	Hem-fir #3	9-5	13-9	17-5	21-3
	Southern pine SS	11-9	18-5	24-3	Note a
	Southern pine #1	11-3	17-8	23-10	Note a
	Southern pine #2	10-9	16-11	21-7	25-7
	Southern pine #3	8-9	12-11	16-3	19-9
	Spruce-pine-fir SS	11-0	17-4	22-10	Note a
	Spruce-pine-fir #1	10-9	16-11	22-4	Note a
	Spruce-pine-fir #2	10-9	16-11	22-4	Note a
	Spruce-pine-fir #3	9-5	13-9	17-5	21-3

(Portions of table not shown for brevity and clarity.)



802.11 Roof Uplift Resistance 2012

- The provisions for roof connections to resist wind uplift forces have been updated to current standards and simplified for ease of use. Table R802.11 has been replaced to provide accurate values for both low- and high-slope roofs in Wind Exposure Categories B and C.



2012

R806 Roof Ventilation

- The provisions for minimum vent area have been revised by placing two exceptions after the general rule to clarify the meaning. The exception for reducing the ventilation area when a vapor retarder is installed on the ceiling now only applies to cold-weather climates. The reduction in vent area based on cross ventilation now requires no less than 40% and no more than 50% (previously 50% and 80%) of the required ventilating area to be placed in the upper portion of the roof and no more than 3 feet below the ridge. The requirement for the upper vents to be at least 3 feet below the ridge. The requirement for the upper vents to be at least 3 feet above the eave vents has been removed.




2015 IRC Transition from the 2009 IRC 113

2012

R903.2.1 Roof Flashing Locations

- The general roof flashing provisions for Chapter 9 now require a kick-out flashing where the eave of the roof intersects a wall to prevent water intrusion into the wall assembly.

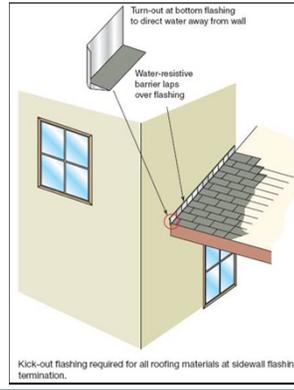


2015 IRC Transition from the 2009 IRC 115

Unvented Attic Assemblies

2012 IRC	2015 IRC
R806.5	Table R806.5
The unvented attic provisions apply to rafter assemblies typically used for vaulted or cathedral ceilings in addition to conventional attics. References to vapor retarders now specify the applicable class as defined in Section R202. Insulation board installed as an air-impermeable barrier must have the edges sealed to provide a continuous barrier.	For unvented attics and unvented rafter spaces, Table R806.5 has a new footnote allowing calculation of insulation thickness when the insulation is placed above the structural roof sheathing.



2015 IRC Transition from the 2009 IRC 114

2012

R903.2.2 Crickets and Saddles

- Unit skylights or roof windows must be installed in accordance with the manufacturer's installation instructions, which may not require a cricket even when they exceed 30 inches in width.



2015 IRC Transition from the 2009 IRC 116

Underlayment

2012 IRC	2015 IRC
<p>R905.2.7.2</p> <p>The requirements for installation of roof covering underlayment have been added for high-wind areas. Adhered underlayment that conforms to ASTM D1970 is exempt from the fastening requirements.</p>	<p>R905.1.1, R905.1.2</p> <p>Roof underlayment provisions have been combined into Section R905.1.1 with three tables listing underlayment type, application, and attachment. Sections on ice barriers from the 2012 IRC are reorganized and combined into Section R905.1.2</p>

2015 IRC Transition from the 2009 IRC
117

R905.2.8.5 Roof Drip Edge

2012

- A roof drip edge is now required for asphalt shingles.

2015 IRC Transition from the 2009 IRC
119

R905.2.8.3 Sidewall Flashing

2012

- For asphalt shingles, the IRC now recognizes both step and continuous base flashings where sloped roofs meet walls. Where the wall has anchored or adhered masonry veneer, or stucco, the provisions are clarified by referencing the applicable section of the code for counterflashing.

2015 IRC Transition from the 2009 IRC
118

R905.7.5 Wood Shingle Application

2015

- The minimum requirements for application of wood shingles are expanded. Fastener type is clarified and a new table lists minimum sizes for box nails. Labeling requirements for fastener packaging have also been added.

TABLE R905.7.5(2) Nail Requirements for Wood Shakes and Wood Shingles

Shakes	Nail Type and Minimum Length	Minimum Head Size	Minimum Shank Diameter
18" Straight-Split	5d Box 1 1/2"	0.19"	0.08"
18" and 24" Handsplit and Resawn	6d Box 2"	0.19"	0.0915"
24" Tapersplit	5d Box 1 1/2"	0.19"	0.08"
18" and 24" Tipersawn	6d Box 2"	0.19"	0.0915"
Shingles	Nail Type and Minimum Length	Minimum Head Size	Minimum Shank Diameter
18" and 18"	3d Box 1 1/2"	0.19"	0.08"
24"	4d Box 1 1/2"	0.19"	0.08"

2015 IRC Transition from the 2009 IRC
120

R905.8.6

2015

Wood Shake Installation

- The minimum requirements for application of wood shakes are expanded. Fastener type is clarified, and a new table lists minimum sizes for box nails. Labeling requirements for fastener packaging have also been added.



2015 IRC Transition from the 2009 IRC

121

R907 Rooftop-Mounted Photovoltaic Systems

2012

- This code provision describes the requirements and limits of rooftop-mounted photovoltaic.



2015 IRC Transition from the 2009 IRC

123

R905.16

2015

Photovoltaic Shingles

- Additional requirements and limits for photovoltaic shingles have been added to Section R905.16



2015 IRC Transition from the 2009 IRC

122

R907.3 Recovering versus Replacement of Roofing

2012

- The hail exposure map, related definitions, and the limitations on reroofing in hail zones have been deleted from the code. A new exception clarifies that the reroofing provisions do not require the removal of self-adhered ice barrier underlayment.



2015 IRC Transition from the 2009 IRC

124

R1003.9.1, R1003.3.3 Masonry ²⁰¹² Chimney Caps and Rain Caps

- New language includes provisions for commonly used masonry chimney caps and rain caps consistent with ASTM C 1283.



2015 IRC Transition from the 2009 IRC

125

Compare two things

2012

- R602.10.3 Required Length of Bracing
- R602.12 Simplified Wall Bracing
- R905.2.7.2 Underlayment

2015

- Table R602.10.3(1) Required Length of Bracing
- Simplified Wall Bracing
- R905.1.1, R905.1.2 Underlayment



2015 IRC Transition from the 2009 IRC

127

R1005.7 ²⁰¹² Factory-Built Chimney Offsets

- Factory-built chimney assemblies must be installed vertically with no offsets greater than 30 degrees. No more than four elbows are permitted within the entire length of chimney assembly.



2015 IRC Transition from the 2009 IRC

126




Decks

- Deck changes in the 2015 code
 - What are the Changes?
 - How will this affect your work?
 - Will the code changes, change the inspection process?



2015 IRC Transition from the 2009 IRC

128

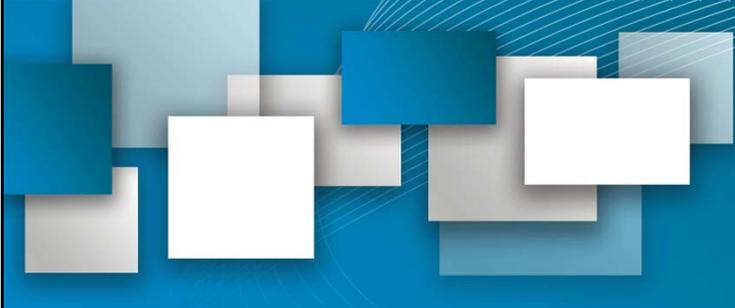


Part 4
**Energy Conservation
 (Chapter 11)**

2015 IRC Transition from the 2009 IRC 129

2015

N1101.13 Compliance Paths

- The compliance paths in the energy provisions have been clarified. The mandatory provisions combined with either the prescriptive provisions or the performance provisions are deemed to comply with the code.



2015 IRC Transition from the 2009 IRC 131

2012

Chapter 11 Energy Efficiency

- The IRC energy efficiency provisions have been replaced with the applicable residential requirements of the IECC.

2015 IRC Transition from the 2009 IRC 130


Permanent Energy Certificate

2012 IRC	2015 IRC
N1101.14 (N1101.16)	N1101.14
The permanent certificate must list the results of the blower door test for air leakage of the building envelope and the results of required duct system testing.	The code now requires the permanent energy certificate to be placed on a wall in proximity to the furnace, in a utility room, or in another approved location inside the building.

2015 IRC Transition from the 2009 IRC 132

N1102.1.3 R-Value Computation- Insulated Siding 2015

- The code now allows insulated siding to be used in the calculation for satisfying the wall insulation *R*-value. The labeled *R*-value for the siding must be reduced by *R*-0.6 for calculation purposes.



Min. R-2 rigid insulation integral with siding material

Siding

2015 IRC Transition from the 2009 IRC 133


N1102.2.7, Table N1102.1.2 R-Value Reduction for Walls with Partial Structural Sheathing 2015

- The allowed *R*-value reduction for portions of walls with structural sheathing and requiring continuous insulation has been moved from footnote h of Table N1102.1.2 and placed in a new section to clarify the application.

2015 IRC Transition from the 2009 IRC 135

N1102.2.4 Access Hatches and Doors 2015

- Vertical doors that access unconditioned attics and crawl spaces do not require an *R*-value to match the required wall insulation. Such doors must comply with the fenestration *U*-factor requirements of Table N1102.1.2.

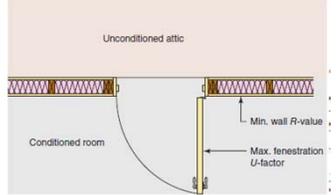

Unconditioned attic

Conditioned room

Min. wall *R*-value

Max. fenestration *U*-factor

2015 IRC Transition from the 2009 IRC 134

N1102.2.8, Table N1102.4.1.1 2015

Floor Framing Cavity Insulation

- The code now permits an air space above required insulation installed in a floor framing cavity above unconditioned space. Table N1102.4.1.1 has been reformatted into three columns to separate the air barrier requirements from the insulation requirements.


TABLE N1102.4.1.1 (402.4.1.1) Air Barrier and Insulation Installation		
Component	Air Barrier Criteria	Insulation Installation Criteria
Floors (including above garage and cantilevered floors)	The air barrier shall be installed at any exposed edge of insulation	Floor framing cavity insulation shall be installed to maintain permanent contact with the underside of subfloor decking, or floor framing cavity insulation shall be permitted to be in contact with the topside of sheathing, or continuous insulation installed on the underside of floor framing; and extends from the bottom to the top of all perimeter floor framing members.

(Portions of table not shown for brevity and clarity.)

2015 IRC Transition from the 2009 IRC 136

Table N1102.4.1.1 Insulation at Wall Corners and Headers 2015

- Insulation requirements at framed wall corners and headers only apply when there is space to install insulation. The minimum insulation thermal resistance is R-3 per inch of insulation.

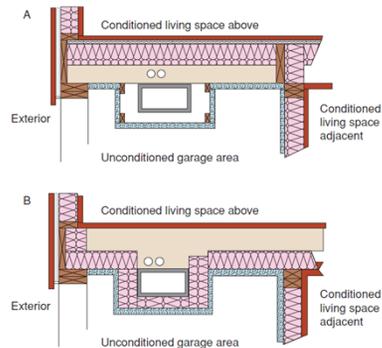

N1102.4.2, Table N1102.4.1.1 Wood-burning Fireplace Doors 2015

- Doors on wood-burning fireplaces must be listed for the application. The requirement for gasketed doors on fireplaces has been removed.



N1102.4.1.2 Building Thermal Envelope Testing 2012

- The code requires a blower door test to be performed on all dwelling units to determine compliance with the maximum air leakage rate for the applicable climate zone.



N1103.3 Duct Sealing and Testing 2015

- The duct sealing and testing provisions have been reorganized to clarify the application. The maximum duct leakage rates are now prescriptive rather than mandatory provisions to accommodate design flexibility.



N1103.3.5 (N1103.2.3) Building Cavities

2012

- Building framing cavities are no longer permitted to be used for return air.



2015 IRC Transition from the 2009 IRC

141

N1102.4.1.2 Building Thermal Envelope Testing

2012

- The code requires a blower door test to be performed on all dwelling units to determine compliance with the maximum air leakage rate for the applicable climate zone



2015 IRC Transition from the 2009 IRC

143

N1103.5 Heated Water Circulation and Temperature Maintenance Systems

2015

- The code now requires automatic controls to maintain hot water temperature for heated water circulation systems and for heat trace temperature maintenance systems when such systems are installed. To save energy, continuously operating circulation pumps are no longer permitted. Heat trace systems must comply with one of the referenced standards.



2015 IRC Transition from the 2009 IRC

142

N1103.5.3 (N1103.4.2) Hot Water Pipe Insulation

2012

- The code sets minimum insulation requirements for hot water piping



2015 IRC Transition from the 2009 IRC


144

N1104.1 2012
Lighting Equipment

- High-efficacy lamps are required in at least 75 percent of permanent lighting fixtures.



2015 IRC Transition from the 2009 IRC 145

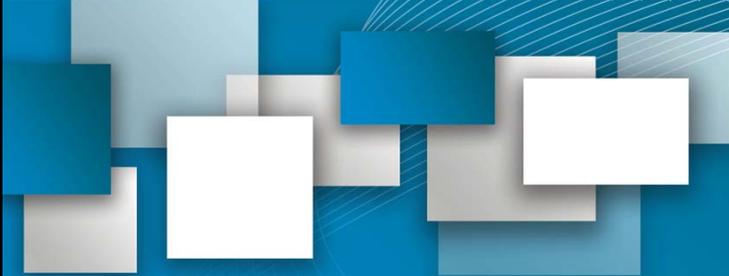

Part 5
Mechanical
(Chapter 12 through 32)

2015 IRC Transition from the 2009 IRC 147

DISCUSSION
 **Energy**

- In the 2012 IECC Code, how did the residential Code change?
- How will the permanent energy certificate effect your job? What will you be looking for in the certificate?



2015 IRC Transition from the 2009 IRC 146

M1301 Identification and Certification 2012
of Pipe, Tubing, and Fittings

- All pipe, tubing, and fittings used in mechanical systems now require a manufacturer's mark and third-party testing or certification. New definitions supplement the provisions.



2015 IRC Transition from the 2009 IRC 148

M1411.6

2012

Locking Access Port Caps

- The code now recognizes any approved means to prevent unauthorized access to outdoor refrigerant ports.



2015 IRC Transition from the 2009 IRC

149

M1502.4.4, M1502.4.5 Dryer Exhaust Duct Power Ventilators

2015

- The code now recognizes the use of dryer exhaust duct power ventilators (DEDPVs) to increase the allowable exhaust duct length for clothes dryers.



2015 IRC Transition from the 2009 IRC

151

M1502.4

2012

Dryer Exhaust Duct

- The maximum support spacing for dryer exhaust ducts has increased from 4 feet to 12 feet. Dryer exhaust ducts now specifically require mechanical fastening. Screw fasteners are permitted to penetrate the exhaust duct no more than 1/8 inch. The maximum specified length of dryer exhaust duct has been increased from 25 to 35 feet and now matches the corresponding dryer exhaust provisions of the IMC, IFGC, and the IRC fuel-gas provisions.



2015 IRC Transition from the 2009 IRC

150

M1502.4.6

2015

Dryer Duct Length Identification

- A permanent label identifying the concealed length of the dryer exhaust duct is no longer required where the equivalent duct length does not exceed 35ft. For the dryer exhaust duct exceeding 35ft, a label or tag is required whether the duct is concealed or not



2015 IRC Transition from the 2009 IRC

152

2015

M1502.4.6 Dryer Duct Length Identification

>35 ft. equivalent length

Backdraft damper

Termination hood

Screen not permitted

4-in. dia. smooth metal dryer duct (concealed or unconcealed)

Max. 6 ft.

Exposed listed transition duct

Dryer

Permanent label or tag identifying the total length of duct required

≤35 ft. equivalent length

Backdraft damper

Termination hood

Screen not permitted

4-in. dia. smooth metal dryer duct

Exposed listed transition duct

Dryer

Permanent label or tag not required

153

2012

M1506 Exhaust Openings

- A minimum clearance of 3 ft. is required between air exhaust terminations and openings into the building.

Bathroom or kitchen exhaust

Min. 3 ft.

Min. 3 ft.

Dryer exhaust

Minimum clearance from exhaust openings.

155

2015

M1503.4 Makeup Air for Range Hoods

- Automatic operation of a mechanical damper is no longer required for supplying makeup air for kitchen exhaust systems exceeding a rating of 400 cubic feet per minute (cfm). Transfer openings are permitted to obtain makeup air from rooms other than the kitchen.

154

2015

M1506.2 Exhaust Duct Length

- The code establishes maximum exhaust duct lengths based on duct diameter, type of duct and the exhaust fan airflow rating.

80 cm bathroom exhaust fan

4-in. dia. smooth wall duct

Max. 31 ft.

156

M1507

2012

Mechanical Ventilation

- Prescriptive design criteria for whole-house ventilation systems have been added to the mechanical ventilation provisions. Mechanical ventilation of kitchens and bathrooms is now described as local exhaust. New definitions for whole-house ventilation and local exhaust have been added to Section R202.



2015 IRC Transition from the 2009 IRC

157

M1601.1.1, Table M1601.1.1, M1601.2

2015

Above-Ground Duct Systems

- The list of duct system requirements has been revised to reference the applicable standards and delete redundant language. The table for material thickness of metal ducts was replaced with what is currently consistent with the SMACNA sheet metal construction standard.



2015 IRC Transition from the 2009 IRC

159

M1601.1

2012

Above-Ground Duct Systems

- Stud cavities of exterior walls are no longer permitted to be used for return air plenums.



2015 IRC Transition from the 2009 IRC


158

M1601.4

2015

Duct Installation

- Tapes and mastics used to seal sheet metal ducts must be listed to UL 181 B as has been required for sealing flexible ducts. Snap-lock and button-lock seams are no longer exempt from the sealing requirements.

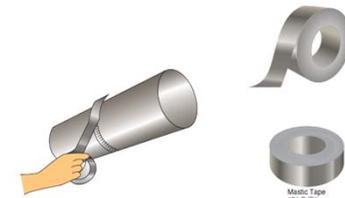

2015 IRC Transition from the 2009 IRC

160

M1601.4.1 Duct Joints, Seams and Connections

2012

- The IRC provisions for duct connections have been replaced with language from the IMC and now reference the SMACNA HAVAC Duct Construction Standards. Unlisted duct tape is not permitted for sealing joints or seams of ductwork.



2015 IRC Transition from the 2009 IRC

161

M1602.2 Prohibited Sources of Outdoor and Return Air

2015

- The prohibition on taking return air from a garage does not apply to an HVAC system that serves the garage only. Mechanical rooms are no longer listed as prohibited sources of return air. Modifications of the 10-foot rule for separation of return air inlets and fuel-burning appliances clarifies that the requirement applies to the draft hood and open combustion chamber of atmospheric burner appliances, not direct vent appliances with sealed combustion chambers.



2015 IRC Transition from the 2009 IRC

163

M1602 Return Air

2015

- The provisions for return air have been simplified and clarified to improve understanding while preserving the intent of keeping contaminants out of the airstream of the heating, ventilation and air-conditioning (HVAC) system. The provisions for outdoor air openings have been removed and the code now references the applicable provisions for outdoor air in Chapter 3.



2015 IRC Transition from the 2009 IRC

162

M1901 Ranges and Ovens

2012

- The provisions for kitchen ranges have been updated to match those for gas-fired ranges in Section G2447. References in Sections M1504.1 and M1505.1 alert the code user to specific provisions related to installation of cooking appliances above ranges and clearances for open-top broiler units. Mandatory code language now clarifies that cooking appliances used in swellings must be listed and labeled for household use. Commercial cooking appliances are not permitted in dwelling units.



2015 IRC Transition from the 2009 IRC

164

M2301, M2302 Thermal and Photovoltaic Solar Energy Systems

2015

- Photovoltaic solar energy systems have been added to the mechanical provisions of the IRC to distinguish them from thermal solar energy systems.




2015 IRC Transition from the 2009 IRC

165

G2404.11 Condensate Pumps

2015

- Condensate pumps located in uninhabitable spaces must be connected to the appliance to shut down the equipment in the event of pump failure.

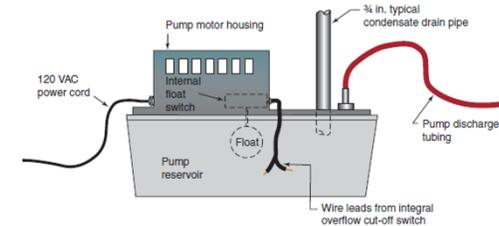

2015 IRC Transition from the 2009 IRC

167

Part 6

Fuel Gas (Chapter 24)

2015 IRC Transition from the 2009 IRC

166

G2409.1 Reduced Clearance to Combustible Materials

2012

- Gypsum board is now specifically identified as a combustibile material for purposes of determining required clearances around gas-fired appliances.




2015 IRC Transition from the 2009 IRC

168

G2411.1.1 Electrical Bonding of Corrugated Stainless Steel Tubing 2015

- The maximum allowable length of the bonding jumper for corrugated stainless steel tubing (CSST) is 75ft. Bonding methods must comply with NFPA 70 and devices, such as clamps, must be listed in accordance with UL 467.



2015 IRC Transition from the 2009 IRC

G2413.2 Maximum Gas Demand 2015

- Table G2413.2 and the reference to it were deleted to clarify that the code requires the actual maximum input rating of the appliances to be known and used for gas pipe sizing purposes.



2015 IRC Transition from the 2009 IRC

171

G2412, G2415 Pipe Identification and Certification 2012

- All pipe, tubing, and fittings used in a fuel-gas system now require a manufacturer's mark and third-party testing or certification. New definitions supplement the provisions.



2015 IRC Transition from the 2009 IRC

170

G2414.6 Plastic Pipe, Tubing and Fitting 2015

- PVC and CPVC pipe are expressly prohibited materials for supplying fuel gas.



2015 IRC Transition from the 2009 IRC

172

G2415.5 Fittings in Concealed Locations 2015

- This section retains the basic intent while being completely reorganized to clarify the correct application. Threaded elbows, tees and coupling are now specifically approved for concealed locations as the code always intended. The code now provides the applicable referenced standards for fittings that are listed for concealed locations.



2015 IRC Transition from the 2009 IRC

173

G2419.4 Sediment Trap 2012

- A new figure illustrates the correct configuration of a sediment trap. Gas-fired decorative vented appliances installed in vented fireplaces and gas fireplaces are not required to be equipped with a sediment trap.



2015 IRC Transition from the 2009 IRC

175

G2415.7 Protection of Concealed Piping Against Physical Damage 2015

- The section on protection of piping has been completely rewritten to address more than just bored holes and notches in structural members. It now addresses piping parallel to framing members and piping within framing members. The new text requires that the protection extend well beyond the edge of members that are bored or notched.



2015 IRC Transition from the 2009 IRC

174

G2421.2 Medium-Pressure Regulators 2015

- Medium-Pressure (MP) line regulators installed in rigid piping must have a union installed to allow removal of the regulator.



2015 IRC Transition from the 2009 IRC

176

G2422.1 Connecting Portable and Movable Appliances 2015

- Where portable gas appliances are used outdoors, such as gas grills, fire pits, and patio heaters, the options for connecting to the gas distribution system are practically limited to gas hoses designed for the purpose. Such hoses must comply with ANSI Z21.54.



2015 IRC Transition from the 2009 IRC

177

G2427.4.1, G2427.6.8.3 Plastic Piping for Appliance Vents 2015

- The approval of plastic pipe for venting appliances is no longer a responsibility of the building official and, instead that responsibility rests with the appliance manufacturer and the appliance listing agency. The code previously addressed only vents, which are defined as listed and labeled factory-made products. The code is no longer silent on the sizing of plastic pipe vents that do not fall under the definition of “vent”.




2015 IRC Transition from the 2009 IRC

179

G2426.7.1 Door Clearance to Vent Terminals 2015

- An appliance vent terminal is not permitted in a location with 12 inches of the arc of a swinging door.

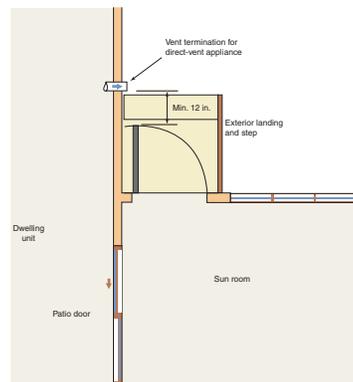


2015 IRC Transition from the 2009 IRC

178

G2427.8 Venting System Termination Location 2015

- New text addresses the location of sidewall vent terminals with respect to adjoining buildings. A 10-foot separation is required when a vent discharges in the direction of an opening in an adjacent building.

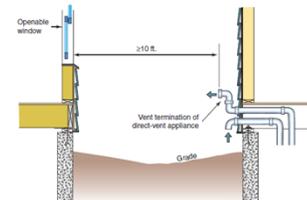

2015 IRC Transition from the 2009 IRC

180

G2439.4, G2439.7

2015

Clothes Dryer Exhaust Ducts

- New text recognizes the use of dryer exhaust duct power ventilators (DEDPVs) to increase the allowable exhaust duct length for clothes dryers. A permanent label identifying the concealed length of dryer exhaust duct is no longer required where the equivalent duct length does not exceed 35ft. For dryer exhaust duct exceeding 35ft, a label or tag is required whether the duct is concealed or not. Instead of prohibiting all duct fasteners such as screws and rivets, the code now limits the penetration of fasteners, where installed.



2015 IRC Transition from the 2009 IRC

181

G2442.4 Prohibited Sources of Outdoor and Return Air

2012

- For an HVAC system that services the garage only, return air is permitted to be taken from the garage. The requirement for a 10-foot separation between return air inlets and fuel-burning appliances applies only to the draft hood and open combustion chamber of atmospheric burner appliances, not direct vent appliances with sealed combustion chambers.




2015 IRC Transition from the 2009 IRC

183

G2439.4, G2439.7

2015

Clothes Dryer Exhaust Ducts

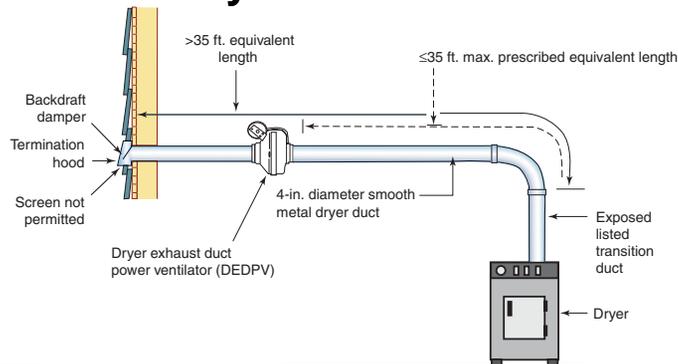

2015 IRC Transition from the 2009 IRC

182

G2447.2 Prohibited Location of Commercial Cooking Appliances

2015

- The code does not prohibit the installation of cooking appliances that are listed as both commercial and domestic appliances.



2015 IRC Transition from the 2009 IRC

184


Part 7
Plumbing
(Chapter 25 through 33)

2015 IRC Transition from the 2009 IRC 185

P2503.5 Drain, Waste, and Vent Systems Testing

2015

- The head pressure for a water test on drain, waste, and vent (DWV) systems has been reduced from 10ft to 5ft.

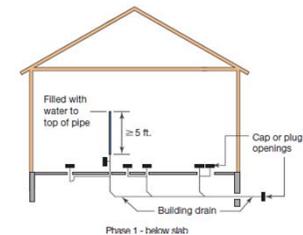

2015 IRC Transition from the 2009 IRC

187

P2502.1, P2503.4 Inspection and Tests for Building Sewer

2015

- New text clarifies the method for examining existing building sewers and building drains when the entire sanitary drainage system is replaced. Internal examination is required to verify the size, slope, and condition of the existing piping. A new provision prescribes a pressure test for a forced sewer at a test pressure of 5psi (34.5 kPa) greater than the pump rating.



2015 IRC Transition from the 2009 IRC

186

P2503.5.1 Rough Plumbing Test

2012

- The IRC no longer permits air testing of plastic piping in DWV systems.



2015 IRC Transition from the 2009 IRC

188

P2601.2 Connections to Drainage Systems

2015

- Waste water from lavatories, bathtubs, showers, clothes washers, and laundry trays is now defined as gray water and is permitted to be discharged to an approved gray-water system.




2015 IRC Transition from the 2009 IRC

189

P2603.2.1 Protection Against Physical Damage

2015

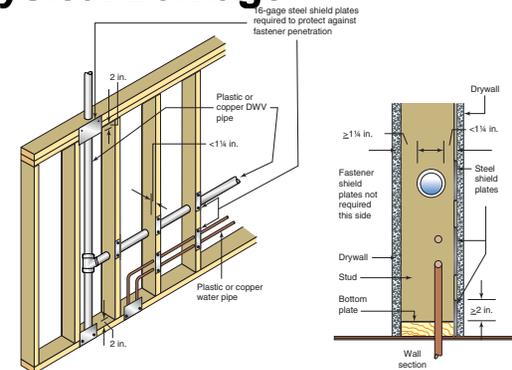

2015 IRC Transition from the 2009 IRC

191

P2603.2.1 Protection Against Physical Damage

2015

- For piping installed through bored holes or in notches, the minimum clearance distance from the concealed piping to the edge of the framing member has been reduced from 1 1/2 in to 1 1/4 in. Protection is required for piping installed less than 1 1/4 in from the edge of the framing member.



2015 IRC Transition from the 2009 IRC

190

P2603.3 Protection Against Corrosion

2015

- The minimum thickness of sheathing material for protection of piping against corrosion has been reduced from 0.025 in to 0.008 in (8mil). The corrosion protection requirement applies to metallic piping other than cast iron, ductile iron, and galvanized steel that is in direct contact with concrete, masonry or steel framing. Previously, protection was only required for materials passing through walls and floors of these materials. All metallic piping requires corrosion protection when located in corrosive soils.



2015 IRC Transition from the 2009 IRC

192

2012

P2603.4 Pipes through Foundation Walls

- A sleeve or relieving arch is not required for pipes passing under a footing.



2015 IRC Transition from the 2009 IRC 193

2012

P2606 Sealing of Annular Spaces

- Provisions for sealing pipe penetrations of the building envelope have been placed in a new section and revised to more precisely prescribe the approved types of materials and their correct application. The new language also correlates with the provisions for sealing against air leakage in the IECC.



2015 IRC Transition from the 2009 IRC 195

2015

Table P2605.1 Piping Support

- Support spacing requirements for PEX and PE-RT tubing 1 ¼ in and greater in diameter have been added to the table. Footnote b of Table P2605.1 clarifies the mid-story guide requirements for some types of vertical pipe 2 ins and smaller in diameter.

TABLE P2605.1 Piping Support

Piping Material	Maximum Horizontal Spacing (feet)	Maximum Vertical Spacing (feet)
Brass Pipe	4 ⁰	4 ⁰
Cross-linked polyethylene (PEX) pipe, 1 inch and smaller	2.67 (32 inches)	10 ⁰
Cross-linked polyethylene (PEX) pipe, 1 ¼ inch and larger	4	10 ⁰
Polyethylene of Raised Temperature (PE-RT) pipe, 1 inch and smaller	2.67 (32 inches)	10 ⁰
Polyethylene of Raised Temperature (PE-RT) pipe, 1 ¼ inch and larger	4	10 ⁰

(Portions of table not shown remain unchanged.)
 a. (No change to text.)
 b. Mid-story guide For sizes 2 inches and smaller, a guide shall be installed midway between required vertical supports. Such guides shall prevent pipe movement in a direction perpendicular to the axis of the pipe.



2015 IRC Transition from the 2009 IRC 194

2012

P2609.1, 2609.4 Identification and Certification

- Pipe, fittings, and plumbing components are required to meet the marking requirements of the applicable referenced standard in addition to bearing the identification of the manufacturer. The code now requires all plumbing products and materials to be listed by a third-party certification agency. Table P2608.4 and third-party testing requirements have been deleted.



2015 IRC Transition from the 2009 IRC 196

Plumbing Fixtures, Waste Receptors

2012 IRC	2015 IRC
P2702.1, P2706.1	P2702.1, P2706.1
The definition of plumbing fixture has been revised to include receptacles and devices that discharge to the drainage system but are not connected to a water supply, such as a floor drains and standpipes. The requirement for strainers on plumbing fixture outlets has been clarified by specifically excluding hub drains and standpipes. Attics and crawlspaces are now listed as prohibited locations for waste receptors and standpipes. Clothes-washer standpipes are permitted to be installed in bathrooms.	A definition of waste receptor has been added to the code. Waste receptors are now permitted in bathrooms and closets.



P2717 Dishwashing Machines

2015

- The code now references the applicable standards for integral air gaps protecting the potable water supply to dishwashers. The term “food waste disposer” replaces “food waste grinder.” Section P2717.2 and P2717.3 regarding dishwasher discharge to the sink tailpiece or the food waste disposer have been combined into a single Section P2717.2, eliminating redundant language and improving understanding of the provisions.



P2709.1, P2709.2 Shower Receptors and Lining

2012

- The distance shower liners must extend above finished thresholds has been reduced from 3 inches to 2 inches. Minimum thickness requirements for PVC and CPE shower liners have been deleted in favor of requirements in referenced standards.




Water Heater Drain Valves and Pans

2012 IRC	2015 IRC
P2801.5	P2801
The provisions for safety pans under water heaters have been clarified by prescribing such protection for water heaters with storage tanks only. Tankless water heaters do not require pans.	The code now specifically requires drain valves with a threaded outlet for water heaters. The water heater pan requirements have been expanded to accept aluminum and plastic pans of the prescribed thickness. The code clarifies that a pan drain is not required when a water heater is replaced and there is no existing drain.



Water Heater Drain Valves and Pans

2015

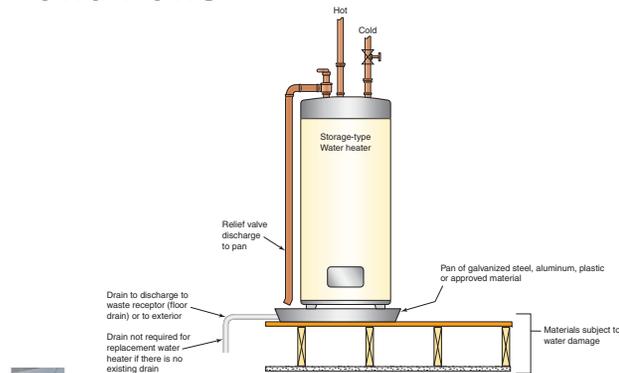

2015 IRC Transition from the 2009 IRC

201

P2901, P2910 through P2913 Nonpotable Water Systems

2015

- Nonpotable water outlets, such as hose connections, that utilize nonpotable water must be identified with a warning and a symbol that nonpotable water is being used. The color purple is established for identifying distribution piping conveying nonpotable water. New Sections P2910 through P2913 are extracted from the IgCC and intend to provide guidance on the collection, storage, and distribution of various types of nonpotable water for residential buildings.

2015 IRC Transition from the 2009 IRC

203

P2804.6.1 Water Heater Relief Valve Discharge Piping

2015

- The temperature and pressure (T&P) relief valve discharge pipe termination must have an air gap suitable to protect the potable water supply distribution system of the building. PEX and PE-RT tubing used for relief valve discharge piping must be one size larger than the T&P valve discharge outlet, and the outlet end of the tubing must be fastened in place.

2015 IRC Transition from the 2009 IRC

202

P2904.2.4.2 Minimum Fire Sprinkler Separation from Obstructions

2012

- A new figure provides prescriptive values for minimum separation distances between fire sprinklers and obstructions. Lesser distances are permitted in accordance with the manufacturer's installation instructions.

2015 IRC Transition from the 2009 IRC

204

P2905 Heated Water Distribution Systems

2015

- Pointers have been added to the IRC plumbing provisions to direct the user to the applicable energy conservation provisions of IRC Chapter 11 related to heated water distribution systems. Section N1103.5 requires automatic controls to maintain hot water temperature for heated water circulation systems and for heat trace temperature maintenance systems when such systems are installed.




2015 IRC Transition from the 2009 IRC

205

P3003.9 Solvent Cementing of PVC Joints

2015

- The application of a primer to drain, waste, and vent PVC pipe and fittings prior to solvent cementing is not required for 4-inch pipe size and smaller, provided that the piping is for a non-pressure application.



Purple primer is no longer required for joints of non-pressure PVC DWV piping 4 inches or less in diameter.



2015 IRC Transition from the 2009 IRC

207

P2906.2 Lead Content of Drinking Water Pipe and Fittings

2015

- The code has a more stringent limitation for lead content in pipe, pipe fittings, joints, valves, faucets, and fixture fittings that convey water used for drinking and cooking.



2015 IRC Transition from the 2009 IRC

206

P3003.19 Joints between Drainage Piping and Water Closets

2012

- Use of waste connector and sealing gasket is now permitted as an alternative to a flanged connection for floor-mounted water closets.



2015 IRC Transition from the 2009 IRC

208

P3005.2 Cleanouts

2015

- The section on cleanouts has been completely reorganized and reworded for clarity. Brass cleanout plugs are only permitted for metallic piping. Where located at a finished wall, the cleanout must be within 1 ½ in of the finished surface. A cleanout is no longer required at the base of each waste or soil stack.




2015 IRC Transition from the 2009 IRC

209

P3008.1 Backwater Valves

2015

- For existing buildings, fixtures that are located above the next upstream manhole cover are allowed to discharge through a backwater valve.

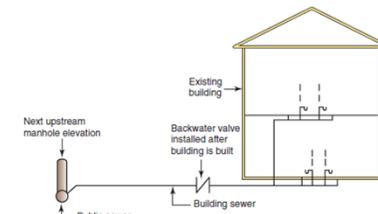

The exception allows this backwater valve arrangement only for existing buildings.



2015 IRC Transition from the 2009 IRC

211

P3007.3.5 Ejector Connection to the Drainage System

2012

- The discharge from ejector pumps is now permitted to connect to soil stacks, waste stacks, and horizontal branch drains in addition to building sewers and building drains.



2015 IRC Transition from the 2009 IRC

210

P3103.1, P3103.2 Vent Terminals

2015

- Where a minimum 3-inch diameter vent terminal is required to prevent frost blockage in cold climates, the 3-inch diameter pipe must extend at least 12 in inside the building's thermal envelope. The minimum 7-foot height requirement for vent terminations applies only to roofs used for purposes similar to residential decks, patios and balconies.



2015 IRC Transition from the 2009 IRC

212

P3103.5 2012
Location of Vent Terminal

- The minimum clearance to vent terminations above openings within 10 feet has been increased from 2 feet to 3 feet.



2015 IRC Transition from the 2009 IRC 213


Part 8
Electrical
(Chapter 34 through 43)



2015 IRC Transition from the 2009 IRC 215

P3201.2 Trap Seal Protection 2015
Against Evaporation

- Trap seal protection against evaporation can now be accomplished in a variety of ways, including trap seal primer valves supplied with nonpotable water and barrier-type trap seal protection devices



A barrier-type trap seal protection device is one of four methods of protecting the floor drain trap seal from evaporation.



2015 IRC Transition from the 2009 IRC 214

E3608.1.2 2012
Concrete-Encased Electrodes

- The provisions for concrete-encased electrodes have been broken into separate parts to clarify the meaning and application.



2015 IRC Transition from the 2009 IRC 216

E3608.4 Supplemental Electrode Required

2012

- A rod, pipe, or later electrode requires a supplemental electrode unless testing confirms that the single electrode has a resistance to earth of 25 ohms or less.




2015 IRC Transition from the 2009 IRC

217

E3901.9 Receptacle Outlets for Garages

2015

- Garage receptacle outlets must be served by a separate branch circuit that does not supply other outlets. At least one receptacle outlet is required for each car space in a garage.

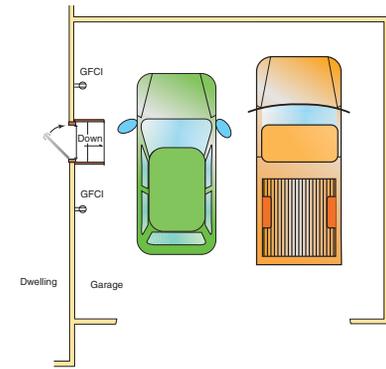


2015 IRC Transition from the 2009 IRC

219

E3901.7 Outdoor Outlets

2012

- An outdoor outlet is now required for any size of deck, porch, or balcony that is accessible from inside the dwelling unit.

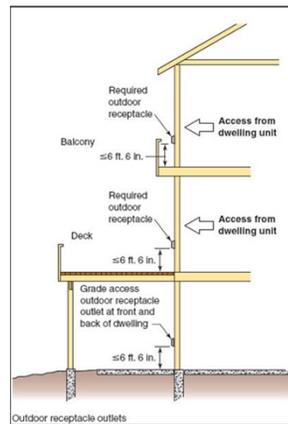

2015 IRC Transition from the 2009 IRC

218

E3901.11 Receptacle Outlets in Foyers

2012

- When exceeding 60 square feet in area, foyers in dwelling units now require receptacle outlets.




2015 IRC Transition from the 2009 IRC

220

E3902.8, E3902.9, E3902.10 Ground-Fault Circuit Interrupter Protection

2015

- Laundry areas have been added to the list of locations requiring ground-fault circuit interrupter (GFCI) protection. Receptacles within 6 feet of bathtubs and showers, and receptacles for dishwashers also require CFGI protection.



GFCI protection required for 125-volt, 15- and 20-amp receptacle outlets in laundry areas and near showers or bathtubs

2015 IRC Transition from the 2009 IRC 221

E3905.8 Boxes at Fan Outlets

2012

- When a ceiling outlet box is wired for a future ceiling fan, the box must be listed for the support of a ceiling fan.

2015 IRC Transition from the 2009 IRC 223

E3902.11 Location of Ground-Fault Circuit Interrupters

2012

- When provided, ground-fault circuit interrupter devices must be placed in a readily accessible location.

2015 IRC Transition from the 2009 IRC 222

E4001.15 Switching Controlling Lighting Loads

2012

- Unless a means of access for rewiring is provided, a grounded circuit conductor must be provided at the switch outlet.

2015 IRC Transition from the 2009 IRC 224

E4002.14

2012

Tamper-Resistant Receptacles

- Receptacles that are located more than 5-1/2 feet above the floor, are part of a luminaire or appliance, or in a dedicated space for an appliance are no longer required to be tamper-resistant.



2015 IRC Transition from the 2009 IRC

225

E4204.2 Bonded Parts of Pools, Spas, and Hut Tubs

2012

- Where walls are at least 5 feet high and less than 3 feet from the edge of the pool, equipotential bonding is required on the pool side of the wall only. Metal parts, including awnings, fences, and door and window frames constructed of metal, require bonding if located within 5 feet of the edge of the pool.




2015 IRC Transition from the 2009 IRC

227

E4203.4.3 Location of Low-Voltage Luminaires Adjacent to Swimming Pools

2015

- Listed low-voltage luminaires meeting the prescribed conditions are permitted to be located less than 5 feet from the water's edge of swimming pools, spas, and hot tubs



Listed low-voltage luminaires meeting all conditions are allowed within 5 feet of swimming pools.



2015 IRC Transition from the 2009 IRC

226

E4209.3 Accessibility to Electrical Equipment of Hydromassage Bathtubs


2012

- When located behind access panels and serving hydromassage bathtubs, receptacle outlets must have their face in direct view and within 1 foot of the access opening.



2015 IRC Transition from the 2009 IRC

228

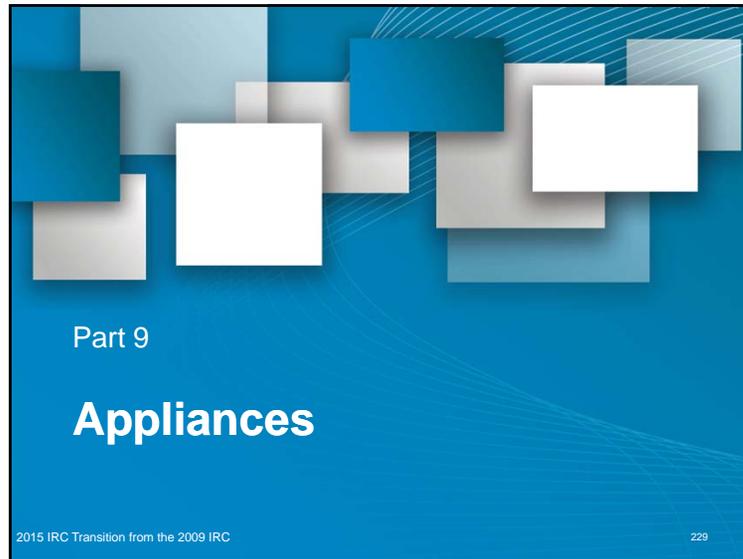

Appendix S 2015

Strawbale Construction

- Prescriptive requirements for strawbale construction have been added as an appendix to the 2015 IRC. Strawbale walls may be non-bearing infill around a structural frame or bearing walls depending upon the method of construction and detailing. Appendix S contains requirements for both construction methods.



2015 IRC Transition from the 2009 IRC 231

Appendix R 2015

Light Straw-Clay Construction

- Prescriptive requirements for light straw-clay construction have been added as an appendix to the 2015 IRC. Light straw-clay walls are non-bearing infill around a structural frame.



2015 IRC Transition from the 2009 IRC 230

DISCUSSION



- What will you do differently with the changes in the code?
- How will the changes affect the inspection and plan review process?



2015 IRC Transition from the 2009 IRC 232

FINAL REFLECTION

Final Reflection

This slide will help the learner to reflect on the day and what they will take back to the job and apply.

- **What?** What happened and what was observed in the training?
- **So what?** What did you learn? What difference did this training make?
- **Now what?** How will you do things differently back on the job as a result of this training?

 2015 IRC Transition from the 2009 IRC 233

Copyright Materials

This presentation is protected by US and International Copyright laws. Reproduction, distribution, display and use of the presentation without written permission of the speaker is prohibited.

© International Code Council 2015



 2015 IRC Transition from the 2009 IRC 235

International Code Council is a Registered Provider with The American Institute of Architects Continuing Education Systems. Credit earned on completion of this program will be reported to CES Records for AIA members. Certificates of Completion for non-AIA members are available on request.

This program is registered with the AIA/CES for continuing professional education. As such, it does not include content that may be deemed or construed to be an approval or endorsement by the AIA of any material of construction or any method or manner of handling, using, distributing, or dealing in any material or product. Questions related to specific materials, methods, and services will be addressed at the conclusion of this presentation.



 2015 IRC Transition from the 2009 IRC

Thank you for participating

To schedule a seminar, contact:

The ICC Training & Education Department
1-888-ICC-SAFE (422-7233) Ext. 33818
or
E-mail: icctraining@iccsafe.org

 2015 IRC Transition from the 2009 IRC 236