



This Tip Sheet reflects code requirements of the 2015 International Building Code (IBC) and ICC A117.1-2009 Accessible and Usable Buildings and Facilities.

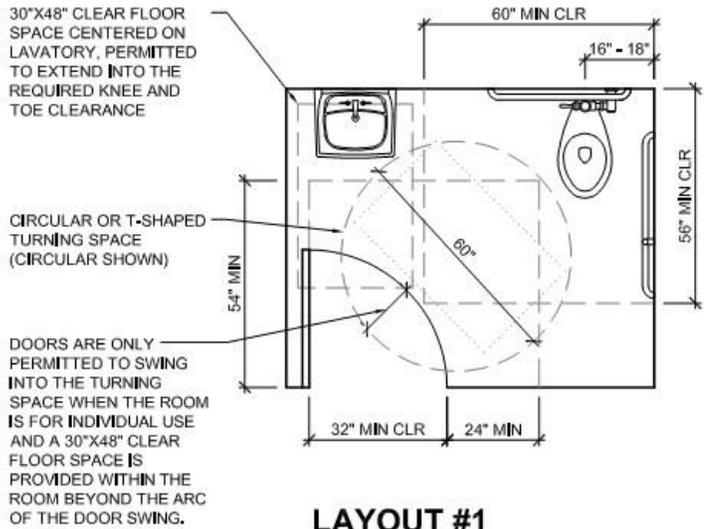


LAYOUT #1


NOTE: SINK AND TOILET CLEARANCES SHOWN IN LAYOUT #1 ARE TYPICAL OF ALL LAYOUTS, UNLESS NOTED OTHERWISE

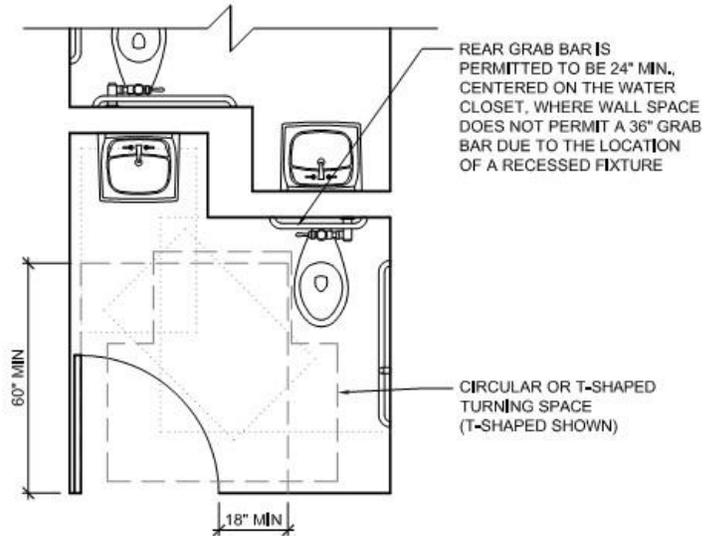

LAYOUT #2

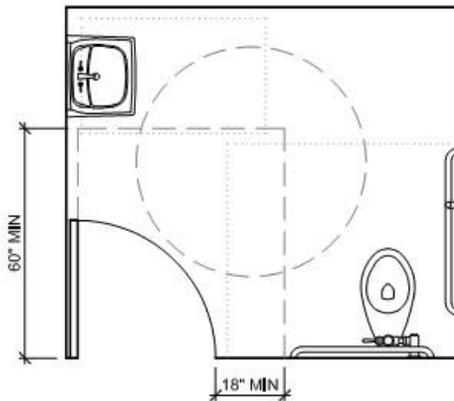

LAYOUT #3



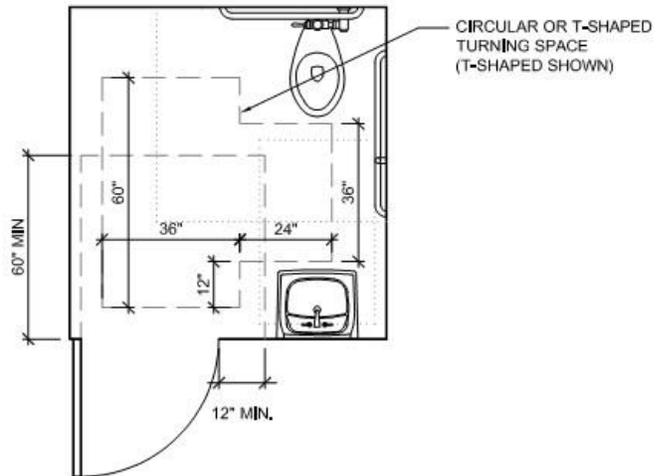


LAYOUT #4

GENERAL INFORMATION:

- The intent of this Tip Sheet is to provide a general understanding of the code requirements and does not address the subject in great detail.
- Additional information can be obtained from your local participating jurisdiction.

Single User Accessible Restrooms

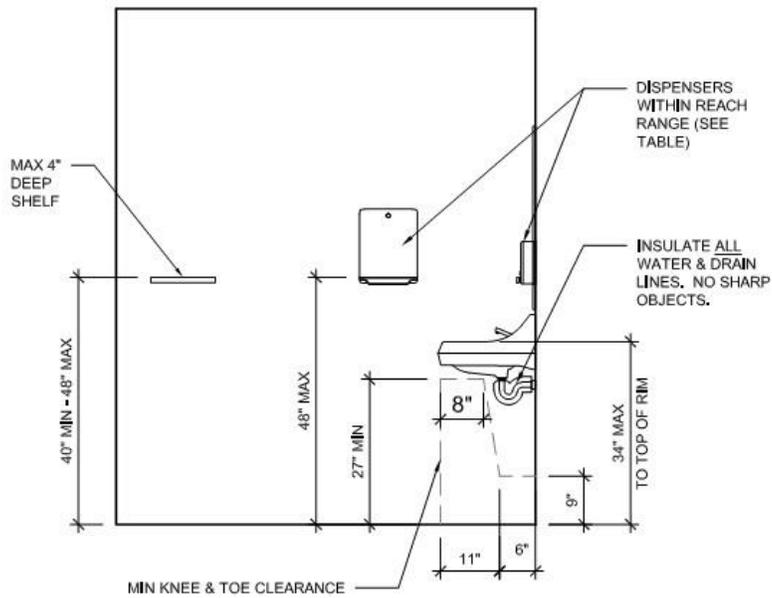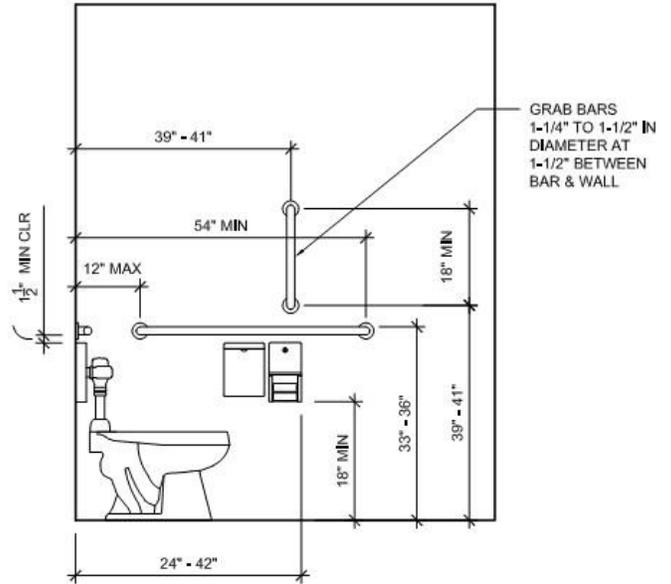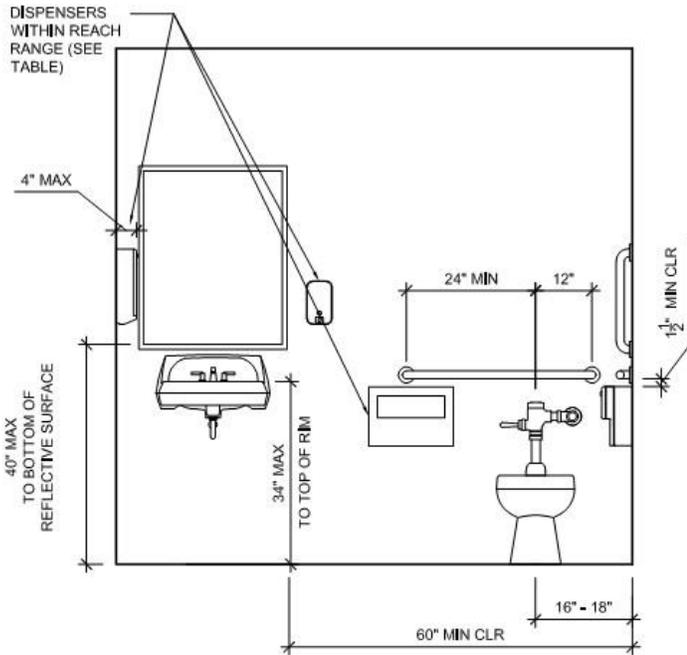

OBSTRUCTION DEPTH, MAX	DISPENSER REACH HT. MAX.
0.5 IN	48 IN
2 IN	46 IN
5 IN	42 IN
6 IN	40 IN
9 IN	36 IN
11 IN	34 IN

REACH RANGE TABLE 603.6

WHERE DISPENSERS, OUTLETS, OR CONTROLS ARE INSTALLED ABOVE OBSTRUCTIONS (LAVATORIES, ETC), ENSURE MAX DEPTH AND HEIGHT IN ACCORDANCE WITH ICC/ANSI A117.1 TABLE 603.6

GENERAL INFORMATION:

- The intent of this Tip Sheet is to provide a general understanding of the code requirements and does not address the subject in great detail.
- Additional information can be obtained from your local participating jurisdiction.